

LOW PROFILE UNIT COOLERS

Technical Guide
Including A2L models meeting DOE minimum AWEF

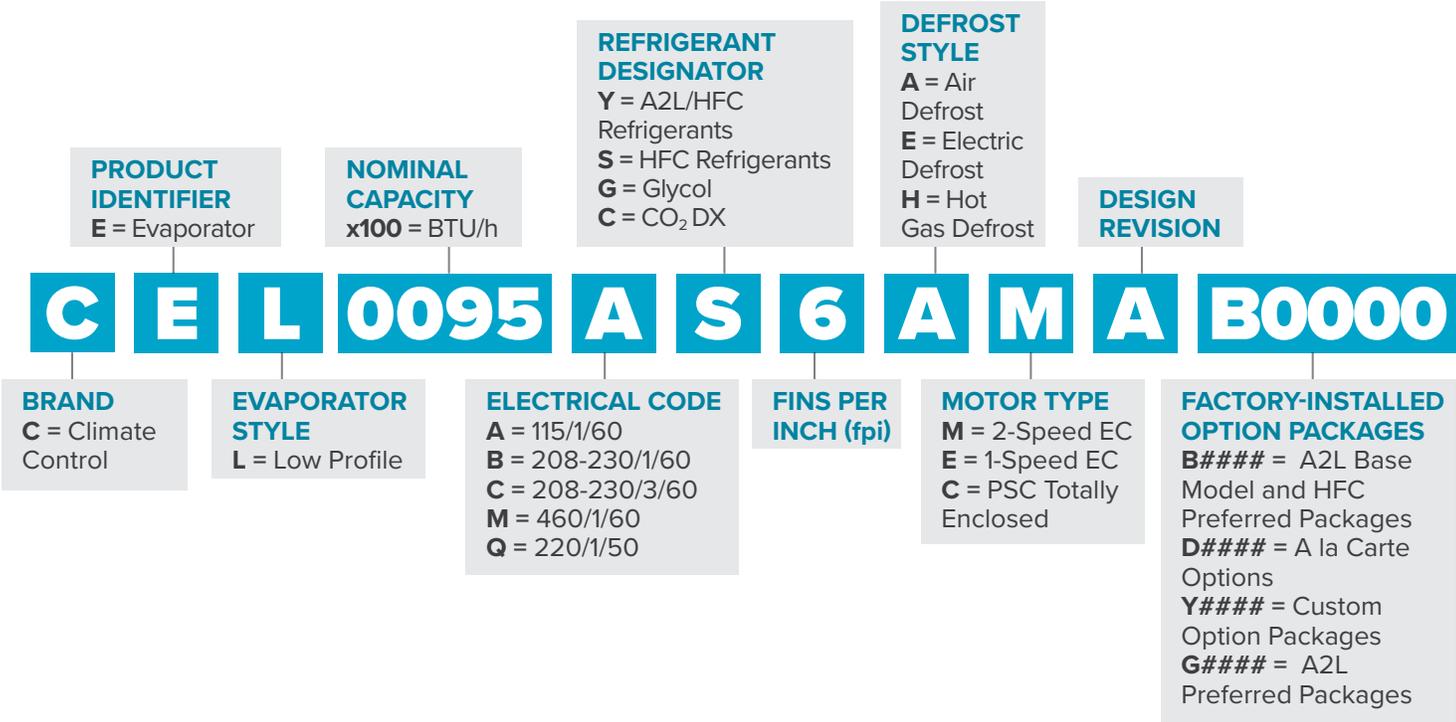


TABLE OF CONTENTS

3	Nomenclature
3	Preferred Option Packages
5	Features & Benefits
7	A2L and A1 Air Defrost
7	A2L Air Defrost- 60 Hz
8	A1 Air Defrost- 60 Hz
9	A1 Air Defrost- 60 Hz (CO ₂ DX)
10	A2L Air Defrost- 50 Hz (For PSC Motors) †
11	A1 Air Defrost- 50 Hz (For PSC Motors) †
12	A1 Air Defrost- 50 Hz (CO ₂ DX)
13	Specifications
13	Air Defrost- 60 Hz
15	Air Defrost- 50 Hz
16	A2L & A1 Electric Defrost
16	A2L Low Temperature Electric Defrost- 60 Hz
18	A1 Low Temperature Electric Defrost- 60 Hz
20	A1 Low Temperature Electric Defrost- 60 Hz (CO ₂ DX)
21	A2L Low Temperature Electric Defrost- 50 Hz (For PSC Motors) †
23	A1 Low Temperature Electric Defrost- 50 Hz (For PSC Motors) †
25	A1 Low Temperature Electric Defrost- 50 Hz (CO ₂ DX)
26	A2L Medium Temperature Electric Defrost- 60 Hz
28	A1 Medium Temperature Electric Defrost- 60 Hz
30	A1 Medium Temperature Electric Defrost- 60 Hz (CO ₂ DX)
31	Specifications
31	Electric Defrost- 60 Hz
33	Electric Defrost- 50 Hz
35	A2L & A1 Hot Gas Defrost
35	A2L Low Temperature Hot Gas Defrost- 60 Hz
37	A1 Low Temperature Hot Gas Defrost- 60 Hz
39	A2L Low Temperature Hot Gas Defrost- 50 Hz (For PSC Motors) †
41	A1 Low Temperature Hot Gas Defrost- 50 Hz (For PSC Motors) †
43	A2L Medium Temperature Hot Gas Defrost 60 Hz
45	A1 Medium Temperature Hot Gas Defrost- 60 Hz
47	Specifications
47	Hot Gas Defrost- 60 Hz
51	Hot Gas Defrost- 50 Hz
53	Physical Data
53	Air Defrost
54	Air Defrost (CO ₂ DX)
55	Electric Defrost
56	Electric Defrost (CO ₂ DX)
57	Hot Gas Defrost
58	Dimensional Drawings
59	AWEF Data
64	Hot Gas Reverse Cycle Kits
67	Replacement Parts
71	Standard Nozzle Selection



NOMENCLATURE



PREFERRED OPTION PACKAGES

(HFC Refrigerants)

Package	Description (standard base model features + indicated options HELow)
B0000	A2L/HFC Base Model
B0200	intelliGen Refrigeration Controller (R-404A/R-448A/R-449A)
B0201	intelliGen Refrigeration Controller (R-407A/R-407C/R-407F)
B0403	Mounted Components (TXV, Solenoid Valve, Electronic T'Stat – R-404A)
B0404	Mounted Components (TXV, Solenoid Valve, Electronic T'Stat – R-407A/C/F)
B0405	Mounted Components (TXV, Solenoid Valve, Electronic T'Stat – R-448A/R-449A)
G0000	Standard base with RDS
G0210	Standard base with RDS + intelliGen™ (R455A)
G0211	Standard base with RDS + intelliGen™ (R454C)
G0212	Standard base with RDS + intelliGen™ (R454A)
G0410	Standard base with RDS + Mounted TXV + Solenoid Valve + Electronic T'Stat (R455A)
G0411	Standard base with RDS + Mounted TXV + Solenoid Valve + Electronic T'Stat (R454C)
G0412	Standard base with RDS + Mounted TXV + Solenoid Valve + Electronic T'Stat (R454A)

PREFERRED OPTION PACKAGES

(CO₂ DX)

Package	Description (standard base model features + indicated options HELow)
B0500 Standard Base	Danfoss EEV (120V) with 1/4" MPT Transducer Connection (Pressure Transducer not included)
B0501	Danfoss EEV (120V) with 1/4" MPT Transducer Connection (Pressure Transducer not included) + Filter Drier
B0502	Sporlan EEV (120V) with 1/4" MPT Transducer Connection (Pressure Transducer not included) + Filter Drier
B0503	Danfoss EEV (120V) with Danfoss Pressure Transducer
B0504	Danfoss EEV (120V) with Danfoss Pressure Transducer + Filter Drier
B0505	Danfoss EEV (120V) with CPC Pressure Transducer
B0506	Danfoss EEV (120V) with CPC Pressure Transducer + Filter Drier
B0507	Sporlan EEV (120V) with Microthermo Pressure Transducer + Filter Drier

FEATURES & BENEFITS

CABINET

- Cabinet design features hinged, removable front access panels on each side for easy access to electrical and refrigeration components.
- Molded fan guard and access panels are made of strong, durable, NSF and UL Sanitation rated lightweight and damage-resistant molded plastic material.
- Quick-removal fan guard/motor assembly for easier servicing of air mover parts.
- Sweat connections to reduce potential for leaks.
- Liquid line solenoid wire harness is factory-installed for quick installation.

COIL

- Internally enhanced tubing and fin design for higher efficiency.
- Coil heater slots have been enlarged for easier installation and replacement.
- Hot gas loop on bottom of coil for easier access is standard on hot gas defrost models.
- Fixed defrost termination for electric, adjustable defrost termination for hot gas.

CONTROLS OPTIONS

- **intelliGen™ Refrigeration Controller (iRC)**
 - Factory mounted, tested and calibrated with an electronic expansion valve, pressure transducer, temperature sensors, control board and User Interface. Standard features include Door Sensor, Product Load Input and Alarm Output.
 - Optional Field installable intelliGen™ Webserver Card (iWC) enables local and remote monitoring on any smart phone, tablet or PC.
 - Optional Field installable intelliGen™ Integration Card (iIC) enables connectivity to BACnet and Modbus.

MOTORS

- Motors plug into wiring harness for easier servicing.
- 2-Speed EC motors standard on Air Defrost models.
- 1-Speed EC motors standard on Electric Defrost & Hot Gas Defrost models.

DRAIN PAN

- Large diameter drain hole (3/4" ID) is located towards the back of the unit.
- Extended drain pan heaters for more uniform defrost throughout the drain pan and additional heat in end compartments.
- Hinged, removable drain pans allow for easy and safe access (3-6 fan units only).

OTHER OPTIONS

- Units available with factory installed mounted components: Expansion Valve, Mechanical Room Thermostat, Solenoid Valve with Dual Voltage Coil.
- Units available with mounted TXV and mounted TXV with solenoid valve.
 - Pre-assembled units come with mounted TXV, liquid line solenoid valve and room thermostat.
 - Available in a master liquid line configuration.
 - Pre-charged units come with mounted TXV, liquid line solenoid valve, room thermostat and quick connect fittings.
- Units available with stainless steel housing and drain pan.
- All units come standard with aluminum fin, copper tube coils. Units available with various coil material / coating options including polyester fin coating, black electrostatic fin coating, copper fins and Bronz-Glow coil coating. Please review our price book for availability.
- Units available with insulated drain pan.

A2L FEATURES AND OPTIONS

- A2L and A1 dual refrigerants compatible models
- Factory mounted Refrigerant Detection System (RDS)
 - Mounted refrigerant leak detection sensors
 - Mounted refrigerant leak mitigation controller
 - Early warning leak detection with relay output for external alert devices
 - Mitigation alarm with relay output for external alarm devices
- Base model option available with or without RDS
- Field mounted Refrigerant Detection System kit available.
- Protection grill for evaporator coil
- Piping protection guards for refrigerant line connections
- Red tags on service valves and connection points as indicators for A2L refrigerants
- A2L labels to meet regulatory requirement

FEATURES & BENEFITS

OUTSTANDING FEATURES



Table 1: Capacity Correction Factors

Electric and Hot Gas Defrost Units				
Saturated Suction Temperature °F	+20	-10	-20	-30
Saturated Suction Temperature °C	-7	-23	-29	-34
Multiply Capacity By	1.15	1.04	1.00	0.90

A2L PERFORMANCE DATA

Application Capacity: Air Defrost- 60 Hz

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	R454A			R454C			Fan Data		
	Application Capacity ¹			Application Capacity ¹					
	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	No. of Fans	CFM	m ³ H
	BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
CEL0045*Y6A^A	4,600	1,348	51	3,800	1,114	50	1	653	1,109
CEL0055*Y6A^A	6,200	1,817	55	5,100	1,495	54	1	610	1,036
CEL0060*Y6A^A	7,900	2,315	55	6,500	1,905	54	1	610	1,036
CEL0095*Y6A^A	10,100	2,960	58	8,300	2,433	55	2	1,305	2,217
CEL0105*Y6A^A	12,600	3,693	60	10,400	3,048	57	2	1,305	2,217
CEL0115*Y6A^A	14,600	4,279	67	12,000	3,517	64	2	1,220	2,073
CEL0125*Y6A^A	15,700	4,601	67	12,900	3,781	64	2	1,220	2,073
CEL0155*Y6A^A	17,000	4,982	74	13,900	4,074	71	3	1,958	3,327
CEL0190*Y6A^A	21,400	6,272	85	17,600	5,158	81	3	1,830	3,109
CEL0250*Y6A^A	24,800	7,268	96	20,400	5,979	92	4	2,440	4,146
CEL0295*Y6A^A	31,000	9,086	106	25,500	7,474	102	5	3,050	5,182
CEL0350*Y6A^A	37,200	10,903	111	30,500	8,939	106	6	3,660	6,218
CEL0380*Y6A^A	44,800	13,130	119	36,900	10,815	114	6	3,660	6,218

New Model	R455A			Fan Data		
	Application Capacity ¹					
	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	No. of Fans	CFM	m ³ H
	BTUH	Watts	Sq. Ft.			
CEL0045*Y6A^A	5,000	1,465	33	1	653	1,109
CEL0055*Y6A^A	6,600	1,934	35	1	610	1,036
CEL0060*Y6A^A	8,400	2,462	35	1	610	1,036
CEL0095*Y6A^A	10,800	3,165	38	2	1,305	2,217
CEL0105*Y6A^A	13,500	3,957	39	2	1,305	2,217
CEL0115*Y6A^A	15,700	4,601	43	2	1,220	2,073
CEL0125*Y6A^A	16,700	4,894	43	2	1,220	2,073
CEL0155*Y6A^A	18,100	5,305	48	3	1,958	3,327
CEL0190*Y6A^A	22,900	6,712	55	3	1,830	3,109
CEL0250*Y6A^A	26,600	7,796	62	4	2,440	4,146
CEL0295*Y6A^A	33,200	9,730	69	5	3,050	5,182
CEL0350*Y6A^A	39,700	11,635	72	6	3,660	6,218
CEL0380*Y6A^A	48,000	14,068	77	6	3,660	6,218

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

A1 PERFORMANCE DATA

Application Capacity: Air Defrost- 60 Hz

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
		Application Capacity ¹		Application Capacity ¹				
		10°F TD/25°F SST	6°C TD/-4°C SST	10°F TD/25°F SST	6°C TD/-4°C SST	No. of Fans	CFM	m ³ H
		BTUH	Watts	BTUH	Watts			
CEL0045*±6A^A	LSC040	4,000	1,200	4,600	1,300	1	653	1,109
CEL0055*±6A^A	LSC052	5,200	1,500	6,100	1,800	1	610	1,036
CEL0060*±6A^A	LSC065 LSC070	6,500	1,900	7,800	2,300	1	610	1,036
CEL0095*±6A^A	LSC070 LSC090	8,000	2,300	10,000	2,900	2	1,305	2,217
CEL0105*±6A^A	LSC090 LSC104	9,200	2,650	12,500	3,600	2	1,305	2,217
CEL0115*±6A^A	LSC120	11,700	3,370	14,500	4,180	2	1,220	2,073
CEL0125*±6A^A	LSC130	13,000	3,800	15,500	4,500	2	1,220	2,073
CEL0155*±6A^A	LSC140	14,000	4,100	16,800	4,900	3	1,958	3,327
CEL0190*±6A^A	LSC156 LSC180	18,000	5,300	21,200	6,200	3	1,830	3,109
CEL0250*±6A^A	LSC208	20,800	6,100	24,600	7,200	4	2,440	4,146
CEL0295*±6A^A	LSC260	26,000	7,600	30,700	9,000	5	3,050	5,182
CEL0350*±6A^A	LSC312	31,200	9,100	36,800	10,800	6	3,660	6,218
CEL0380*±6A^A	LSC370	37,000	10,800	44,400	13,000	6	3,660	6,218

New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
		Application Capacity ¹		Application Capacity ¹				
		10°F TD/25°F SST	6°C TD/-4°C SST	10°F TD/25°F SST	6°C TD/-4°C SST	No. of Fans	CFM	m ³ H
		BTUH	Watts	BTUH	Watts			
CEL0045*±6A^A	LSC040	4,600	1,300	4,600	1,300	1	653	1,109
CEL0055*±6A^A	LSC052	6,100	1,800	6,100	1,800	1	610	1,036
CEL0060*±6A^A	LSC065 LSC070	7,800	2,300	7,800	2,300	1	610	1,036
CEL0095*±6A^A	LSC070 LSC090	10,000	2,900	10,000	2,900	2	1,305	2,217
CEL0105*±6A^A	LSC090 LSC104	12,500	3,600	12,500	3,600	2	1,305	2,217
CEL0115*±6A^A	LSC120	14,500	4,180	14,500	4,180	2	1,220	2,073
CEL0125*±6A^A	LSC130	15,500	4,500	15,500	4,500	2	1,220	2,073
CEL0155*±6A^A	LSC140	16,800	4,900	16,800	4,900	3	1,958	3,327
CEL0190*±6A^A	LSC156 LSC180	21,200	6,200	21,200	6,200	3	1,830	3,109
CEL0250*±6A^A	LSC208	24,600	7,200	24,600	7,200	4	2,440	4,146
CEL0295*±6A^A	LSC260	30,700	9,000	30,700	9,000	5	3,050	5,182
CEL0350*±6A^A	LSC312	36,800	10,800	36,800	10,800	6	3,660	6,218
CEL0380*±6A^A	LSC370	44,400	13,000	44,400	13,000	6	3,660	6,218

Notes:
¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov
* = Electrical Code Designator (see Nomenclature details)
^ = Motor Code Designator (see Nomenclature details)
Net Capacity is available upon request
± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Air Defrost- 60 Hz

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	Legacy Model	CO ₂ DX		Fan Data		
		Application Capacity ¹				
		10°F TD/25°F SST	6°C TD/-4°C SST	No. of Fans	CFM	m ³ H
		BTUH	Watts			
CEL0045*C6A^A	N/A	4,600	1,348	1	653	1,109
CEL0055*C6A^A	N/A	6,100	1,788	1	610	1,036
CEL0060*C6A^A	N/A	7,800	2,286	1	610	1,036
CEL0095*C6A^A	N/A	10,000	2,931	2	1,305	2,217
CEL0105*C6A^A	N/A	12,500	3,663	2	1,305	2,217
CEL0115*C6A^A	N/A	14,500	4,250	2	1,220	2,073
CEL0125*C6A^A	N/A	15,500	4,543	2	1,220	2,073
CEL0155*C6A^A	N/A	16,800	4,924	3	1,958	3,327
CEL0190*C6A^A	N/A	21,200	6,213	3	1,830	3,109
CEL0250*C6A^A	N/A	24,600	7,210	4	2,440	4,146
CEL0295*C6A^A	N/A	30,700	8,997	5	3,050	5,182
CEL0350*C6A^A	N/A	36,800	10,785	6	3,660	6,218
CEL0380*C6A^A	N/A	44,400	13,012	6	3,660	6,218

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

A2L PERFORMANCE DATA

Application Capacity: Air Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	R454A			R454C			Fan Data		
	Application Capacity ¹			Application Capacity ¹					
	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	No. of Fans	CFM	m ³ H
	BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
CEL0045*Y6A^A	4,400	1,290	51	3,600	1,055	50	1	588	999
CEL0055*Y6A^A	5,900	1,729	55	4,800	1,407	54	1	549	933
CEL0060*Y6A^A	7,500	2,198	55	6,200	1,817	54	1	549	933
CEL0095*Y6A^A	9,600	2,814	58	7,900	2,315	55	2	1,175	1,995
CEL0105*Y6A^A	12,000	3,517	60	9,900	2,902	57	2	1,175	1,995
CEL0115*Y6A^A	13,900	4,074	67	11,400	3,341	64	2	1,098	1,866
CEL0125*Y6A^A	14,900	4,367	67	12,200	3,576	64	2	1,098	1,866
CEL0155*Y6A^A	16,100	4,719	74	13,200	3,869	71	3	1,762	2,994
CEL0190*Y6A^A	20,300	5,950	85	16,700	4,894	81	3	1,647	2,798
CEL0250*Y6A^A	23,600	6,917	96	19,400	5,686	92	4	2,196	3,731
CEL0295*Y6A^A	29,500	8,646	106	24,200	7,093	102	5	2,745	4,664
CEL0350*Y6A^A	35,300	10,346	111	29,000	8,499	106	6	3,294	5,597
CEL0380*Y6A^A	42,600	12,485	119	35,000	10,258	114	6	3,294	5,597

New Model	R455A			Fan Data		
	Application Capacity ¹					
	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	No. of Fans	CFM	m ³ H
	BTUH	Watts	Sq. Ft.			
CEL0045*Y6A^A	4,700	1,377	33	1	588	999
CEL0055*Y6A^A	6,300	1,846	35	1	549	933
CEL0060*Y6A^A	8,000	2,345	35	1	549	933
CEL0095*Y6A^A	10,300	3,019	38	2	1,175	1,995
CEL0105*Y6A^A	12,800	3,751	39	2	1,175	1,995
CEL0115*Y6A^A	14,900	4,367	43	2	1,098	1,866
CEL0125*Y6A^A	15,900	4,660	43	2	1,098	1,866
CEL0155*Y6A^A	17,200	5,041	48	3	1,762	2,994
CEL0190*Y6A^A	21,800	6,389	55	3	1,647	2,798
CEL0250*Y6A^A	25,200	7,386	62	4	2,196	3,731
CEL0295*Y6A^A	31,500	9,232	69	5	2,745	4,664
CEL0350*Y6A^A	37,800	11,079	72	6	3,294	5,597
CEL0380*Y6A^A	45,600	13,365	77	6	3,294	5,597

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Air Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
		Application Capacity ¹		Application Capacity ¹				
		10°F TD/25°F SST	6°C TD/-4°C SST	10°F TD/25°F SST	6°C TD/-4°C SST	No. of Fans	CFM	m ³ H
		BTUH	Watts	BTUH	Watts			
CEL0045*±6A^A	LSC040	3,800	1,140	4,370	1,235	1	588	999
CEL0055*±6A^A	LSC052	4,940	1,425	5,795	1,710	1	549	933
CEL0060*±6A^A	LSC065 LSC070	6,175	1,805	7,410	2,185	1	549	933
CEL0095*±6A^A	LSC070 LSC090	7,600	2,185	9,500	2,755	2	1,175	1,995
CEL0105*±6A^A	LSC090 LSC104	8,740	2,518	11,875	3,420	2	1,175	1,995
CEL0115*±6A^A	LSC120	11,115	3,202	13,775	3,971	2	1,098	1,866
CEL0125*±6A^A	LSC130	12,350	3,610	14,725	4,275	2	1,098	1,866
CEL0155*±6A^A	LSC140	13,300	3,895	15,960	4,655	3	1,762	2,994
CEL0190*±6A^A	LSC156 LSC180	17,100	5,035	20,140	5,890	3	1,647	2,798
CEL0250*±6A^A	LSC208	19,760	5,795	23,370	6,840	4	2,196	3,731
CEL0295*±6A^A	LSC260	24,700	7,220	29,165	8,550	5	2,745	4,664
CEL0350*±6A^A	LSC312	29,640	8,645	34,960	10,260	6	3,294	5,597
CEL0380*±6A^A	LSC370	35,150	10,260	42,180	12,350	6	3,294	5,597

New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
		Application Capacity ¹		Application Capacity ¹				
		10°F TD/25°F SST	6°C TD/-4°C SST	10°F TD/25°F SST	6°C TD/-4°C SST	No. of Fans	CFM	m ³ H
		BTUH	Watts	BTUH	Watts			
CEL0045*±6A^A	LSC040	4,370	1,235	4,370	1,235	1	588	999
CEL0055*±6A^A	LSC052	5,795	1,710	5,795	1,710	1	549	933
CEL0060*±6A^A	LSC065 LSC070	7,410	2,185	7,410	2,185	1	549	933
CEL0095*±6A^A	LSC070 LSC090	9,500	2,755	9,500	2,755	2	1,175	1,995
CEL0105*±6A^A	LSC090 LSC104	11,875	3,420	11,875	3,420	2	1,175	1,995
CEL0115*±6A^A	LSC120	13,775	3,971	13,775	3,971	2	1,098	1,866
CEL0125*±6A^A	LSC130	14,725	4,275	14,725	4,275	2	1,098	1,866
CEL0155*±6A^A	LSC140	15,960	4,655	15,960	4,655	3	1,762	2,994
CEL0190*±6A^A	LSC156 LSC180	20,140	5,890	20,140	5,890	3	1,647	2,798
CEL0250*±6A^A	LSC208	23,370	6,840	23,370	6,840	4	2,196	3,731
CEL0295*±6A^A	LSC260	29,165	8,550	29,165	8,550	5	2,745	4,664
CEL0350*±6A^A	LSC312	34,960	10,260	34,960	10,260	6	3,294	5,597
CEL0380*±6A^A	LSC370	42,180	12,350	42,180	12,350	6	3,294	5,597

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Air Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	Legacy Model	CO ₂ DX		Fan Data		
		Application Capacity ¹				
		10°F TD/25°F SST	6°C TD/-4°C SST	No. of Fans	CFM	m ³ H
		BTUH	Watts			
CEL0045*C6A^A	N/A	4,370	1,281	1	588	999
CEL0055*C6A^A	N/A	5,795	1,698	1	549	933
CEL0060*C6A^A	N/A	7,410	2,172	1	549	933
CEL0095*C6A^A	N/A	9,500	2,784	2	1,175	1,996
CEL0105*C6A^A	N/A	11,875	3,480	2	1,175	1,996
CEL0115*C6A^A	N/A	13,775	4,037	2	1,098	1,866
CEL0125*C6A^A	N/A	14,725	4,315	2	1,098	1,866
CEL0155*C6A^A	N/A	15,960	4,677	3	1,762	2,994
CEL0190*C6A^A	N/A	20,140	5,902	3	1,647	2,798
CEL0250*C6A^A	N/A	23,370	6,849	4	2,196	3,731
CEL0295*C6A^A	N/A	29,165	8,547	5	2,745	4,664
CEL0350*C6A^A	N/A	34,960	10,246	6	3,294	5,597
CEL0380*C6A^A	N/A	42,180	12,362	6	3,294	5,597

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

SPECIFICATIONS

Air Defrost- 60 Hz

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

		2-Speed EC Motor (Totally Enclosed)							
		115/1/60				208-230/1/60			
New Model	HP	Amps	Watts	MCA	MOPD	Amps	Watts	MCA	MOPD
CEL0045*±6AMA	1/20	0.9	55	1.1	20	0.5	55	0.6	15
CEL0055*±6AMA	1/20	0.9	55	1.1	20	0.5	55	0.6	15
CEL0060*±6AMA	1/20	0.9	55	1.1	20	0.5	55	0.6	15
CEL0095*±6AMA	1/20	1.8	110	2.0	20	1.0	110	1.1	15
CEL0105*±6AMA	1/20	1.8	110	2.0	20	1.0	110	1.1	15
CEL0115*±6AMA	1/20	1.8	110	2.0	20	1.0	110	1.1	15
CEL0125*±6AMA	1/20	1.8	110	2.0	20	1.0	110	1.1	15
CEL0155*±6AMA	1/20	2.7	165	2.9	20	1.5	165	1.6	15
CEL0190*±6AMA	1/20	2.7	165	2.9	20	1.5	165	1.6	15
CEL0250*±6AMA	1/20	3.6	220	3.8	20	2.0	220	2.1	15
CEL0295*±6AMA	1/20	4.5	275	4.7	20	2.5	275	2.6	15
CEL0350*±6AMA	1/20	5.4	330	5.6	20	3.0	330	3.1	15
CEL0380*±6AMA	1/20	5.4	330	5.6	20	3.0	330	3.1	15

		1-Speed EC Motor (Totally Enclosed)							
		115/1/60				208-230/1/60			
New Model	HP	Amps	Watts	MCA	MOPD	Amps	Watts	MCA	MOPD
CEL0045*±6AEA	1/20	0.9	55	1.1	20	0.5	59	0.6	15
CEL0055*±6AEA	1/20	0.9	55	1.1	20	0.5	59	0.6	15
CEL0060*±6AEA	1/20	0.9	55	1.1	20	0.5	59	0.6	15
CEL0095*±6AEA	1/20	1.8	110	2.0	20	1.0	118	1.1	15
CEL0105*±6AEA	1/20	1.8	110	2.0	20	1.0	118	1.1	15
CEL0115*±6AEA	1/20	1.8	110	2.0	20	1.0	118	1.1	15
CEL0125*±6AEA	1/20	1.8	110	2.0	20	1.0	118	1.1	15
CEL0155*±6AEA	1/20	2.7	165	2.9	20	1.5	177	1.6	15
CEL0190*±6AEA	1/20	2.7	165	2.9	20	1.5	177	1.6	15
CEL0250*±6AEA	1/20	3.6	220	3.8	20	2.0	236	2.1	15
CEL0295*±6AEA	1/20	4.5	275	4.7	20	2.5	295	2.6	15
CEL0350*±6AEA	1/20	5.4	330	5.6	20	3.0	354	3.1	15
CEL0380*±6AEA	1/20	5.4	330	5.6	20	3.0	354	3.1	15

Notes:

* = Electrical Code Designator (see Nomenclature details)
 ± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Air Defrost- 60 Hz

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	HP	PSC Motor (Totally Enclosed)											
		115/1/60				208-230/1/60				460/1/60			
		Amps	Watts	MCA	MOPD	Amps	Watts	MCA	MOPD	Amps	Watts	MCA	MOPD
CEL0045*±6ACA	1/20	1.0	82	1.3	20	0.5	91	0.6	15	0.4	117	0.5	15
CEL0055*±6ACA	1/20	1.0	82	1.3	20	0.5	91	0.6	15	0.4	117	0.5	15
CEL0060*±6ACA	1/20	1.0	82	1.3	20	0.5	91	0.6	15	0.4	117	0.5	15
CEL0095*±6ACA	1/20	2.0	164	2.3	20	1.0	182	1.1	15	0.8	234	0.9	15
CEL0105*±6ACA	1/20	2.0	164	2.3	20	1.0	182	1.1	15	0.8	234	0.9	15
CEL0115*±6ACA	1/20	2.0	164	2.3	20	1.0	182	1.1	15	0.8	234	0.9	15
CEL0125*±6ACA	1/20	2.0	164	2.3	20	1.0	182	1.1	15	0.8	234	0.9	15
CEL0155*±6ACA	1/20	3.0	246	3.3	20	1.5	273	1.6	15	1.2	351	1.3	15
CEL0190*±6ACA	1/20	3.0	246	3.3	20	1.5	273	1.6	15	1.2	351	1.3	15
CEL0250*±6ACA	1/20	4.0	328	4.3	20	2.0	364	2.1	15	1.6	468	1.7	15
CEL0295*±6ACA	1/20	5.0	410	5.3	20	2.5	455	2.6	15	2.0	585	2.1	15
CEL0350*±6ACA	1/20	6.0	492	6.3	20	3.0	546	3.1	15	2.4	702	2.5	15
CEL0380*±6ACA	1/20	6.0	492	6.3	20	3.0	546	3.1	15	2.4	702	2.5	15

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Air Defrost- 50 Hz

Please consult AWEF table on page 59 to confirm model meets DOE minimum AWEF

New Model	HP	2-Speed EC Motor (Totally Enclosed)				1-Speed EC Motor (Totally Enclosed)				PSC Motor (Totally Enclosed)			
		220/1/50				220/1/50				220/1/50			
		Amps	Watts	MCA	MOPD	Amps	Watts	MCA	MOPD	Amps	Watts	MCA	MOPD
CEL0045*±6A^A	1/20	0.5	55	0.6	15	0.5	59	0.6	15	0.5	65	0.6	15
CEL0055*±6A^A	1/20	0.5	55	0.6	15	0.5	59	0.6	15	0.5	65	0.6	15
CEL0060*±6A^A	1/20	0.5	55	0.6	15	0.5	59	0.6	15	0.5	65	0.6	15
CEL0095*±6A^A	1/20	1.0	110	1.1	15	1.0	118	1.1	15	1.0	130	1.1	15
CEL0105*±6A^A	1/20	1.0	110	1.1	15	1.0	118	1.1	15	1.0	130	1.1	15
CEL0115*±6A^A	1/20	1.0	110	1.1	15	1.0	118	1.1	15	1.0	130	1.1	15
CEL0125*±6A^A	1/20	1.0	110	1.1	15	1.0	118	1.1	15	1.0	130	1.1	15
CEL0155*±6A^A	1/20	1.5	165	1.6	15	1.5	177	1.6	15	1.5	195	1.6	15
CEL0190*±6A^A	1/20	1.5	165	1.6	15	1.5	177	1.6	15	1.5	195	1.6	15
CEL0250*±6A^A	1/20	2.0	220	2.1	15	2.0	236	2.1	15	2.0	260	2.1	15
CEL0295*±6A^A	1/20	2.5	275	2.6	15	2.5	295	2.6	15	2.5	325	2.6	15
CEL0350*±6A^A	1/20	3.0	330	3.1	15	3.0	354	3.1	15	3.0	390	3.1	15
CEL0380*±6A^A	1/20	3.0	330	3.1	15	3.0	354	3.1	15	3.0	390	3.1	15

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	R454A			R454C			Fan Data		
		Application Capacity ¹			Application Capacity ¹					
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum	10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum	No. of Fans	CFM	m ³ H
		BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
6	CELO040*Y6E^A	3,800	1,114	51	3,200	938	49	1	685	1,164
6	CELO045*Y6E^A	5,100	1,495	54	4,400	1,290	52	1	641	1,088
6	CELO065*Y6E^A	7,000	2,052	60	6,000	1,758	57	2	1,371	2,329
6	CELO080*Y6E^A	8,100	2,374	60	7,000	2,052	57	2	1,371	2,329
6	CELO100*Y6E^A	9,600	2,814	66	8,200	2,403	64	2	1,281	2,176
6	CELO130*Y6E^A	13,100	3,839	69	11,200	3,283	66	3	2,056	3,493
6	CELO155*Y6E^A	15,500	4,543	85	13,300	3,898	82	3	1,922	3,265
6	CELO170*Y6E^A	17,400	5,100	84	14,900	4,367	80	4	2,741	4,658
6	CELO205*Y6E^A	19,500	5,715	96	16,700	4,894	92	4	2,562	4,353
6	CELO240*Y6E^A	21,700	6,360	107	18,600	5,451	102	5	3,203	5,441
6	CELO255*Y6E^A	26,100	7,649	101	22,300	6,536	97	6	4,112	6,986
6	CELO310*Y6E^A	30,500	8,939	118	26,100	7,649	113	6	3,843	6,529
4	CELO045*Y4E^A	4,400	1,290	55	3,700	1,084	52	1	667	1,132
4	CELO070*Y4E^A	7,200	2,110	60	6,100	1,788	57	2	1,425	2,422
4	CELO090*Y4E^A	8,500	2,491	67	7,300	2,140	64	2	1,332	2,263
4	CELO135*Y4E^A	11,700	3,429	84	10,000	2,931	81	3	1,998	3,395
4	CELO180*Y4E^A	15,800	4,631	96	13,500	3,957	92	4	2,664	4,527
4	CELO220*Y4E^A	19,000	5,569	107	16,300	4,777	102	5	3,331	5,659
4	CELO275*Y4E^A	25,100	7,356	118	21,500	6,301	113	6	3,997	6,790

Notes:
¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov
 * = Electrical Code Designator (see Nomenclature details)
 ^ = Motor Code Designator (see Nomenclature details)
 Net Capacity is available upon request
 ± = Y/S (see Nomenclature details)

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

		R455A					
		Application Capacity ¹			Fan Data		
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum			
FPI	New Model	BTUH	Watts	Sq. Ft.	No. of Fans	CFM	m ³ H
6	CEL0040*Y6E^A	3,700	1,084	33	1	685	1,164
6	CEL0045*Y6E^A	5,000	1,465	35	1	641	1,088
6	CEL0065*Y6E^A	6,800	1,993	39	2	1,371	2,329
6	CEL0080*Y6E^A	8,000	2,345	39	2	1,371	2,329
6	CEL0100*Y6E^A	9,400	2,755	43	2	1,281	2,176
6	CEL0130*Y6E^A	12,800	3,751	45	3	2,056	3,493
6	CEL0155*Y6E^A	15,200	4,455	55	3	1,922	3,265
6	CEL0170*Y6E^A	17,000	4,982	54	4	2,741	4,658
6	CEL0205*Y6E^A	19,100	5,598	62	4	2,562	4,353
6	CEL0240*Y6E^A	21,300	6,243	69	5	3,203	5,441
6	CEL0255*Y6E^A	25,600	7,503	66	6	4,112	6,986
6	CEL0310*Y6E^A	29,800	8,734	77	6	3,843	6,529
4	CEL0045*Y4E^A	4,300	1,260	40	1	667	1,132
4	CEL0070*Y4E^A	7,000	2,052	43	2	1,425	2,422
4	CEL0090*Y4E^A	8,400	2,462	48	2	1,332	2,263
4	CEL0135*Y4E^A	11,500	3,370	55	3	1,998	3,395
4	CEL0180*Y4E^A	15,500	4,543	62	4	2,664	4,527
4	CEL0220*Y4E^A	18,600	5,451	69	5	3,331	5,659
4	CEL0275*Y4E^A	24,600	7,210	77	6	3,997	6,790

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6E^A	LSF035 LSF040	3,500	1,000	3,900	1,000	1	685	1,164
6	CEL0045*±6E^A	LSF040 LSF047	4,700	1,400	5,300	1,600	1	641	1,088
6	CEL0065*±6E^A	LSF065	6,500	1,900	7,200	2,100	2	1,371	2,329
6	CEL0080*±6E^A	LSF075	7,500	2,200	8,400	2,500	2	1,371	2,329
6	CEL0100*±6E^A	LSF090	9,000	2,600	9,900	2,900	2	1,281	2,176
6	CEL0130*±6E^A	LSF120	12,000	3,500	13,500	4,000	3	2,056	3,493
6	CEL0155*±6E^A	LSF140	14,000	4,100	16,000	4,700	3	1,922	3,265
6	CEL0170*±6E^A	LSF160	16,000	4,700	17,900	5,200	4	2,741	4,658
6	CEL0205*±6E^A	LSF180	18,000	5,300	20,100	5,900	4	2,562	4,353
6	CEL0240*±6E^A	LSF200	20,000	5,900	22,800	6,600	5	3,203	5,441
6	CEL0255*±6E^A	LSF240	24,000	7,000	26,900	7,900	6	4,112	6,986
6	CEL0310*±6E^A	LSF280	28,000	8,200	31,400	9,200	6	3,843	6,529
4	CEL0045*±4E^A	LFF041	4,100	1,200	4,500	1,300	1	667	1,132
4	CEL0070*±4E^A	LFF068	6,800	2,000	7,400	2,200	2	1,425	2,422
4	CEL0090*±4E^A	LFF080	8,000	2,300	8,800	2,600	2	1,332	2,263
4	CEL0135*±4E^A	LFF102	10,200	3,000	12,800	3,700	3	1,998	3,395
4	CEL0180*±4E^A	LFF136	13,600	4,000	17,300	5,000	4	2,664	4,527
4	CEL0220*±4E^A	LFF170	17,000	5,000	19,500	5,600	5	3,331	5,659
4	CEL0275*±4E^A	LFF204 LFF235	23,500	6,900	25,900	7,600	6	3,997	6,790

Notes:
¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov
 * = Electrical Code Designator (see Nomenclature details)
 ^ = Motor Code Designator (see Nomenclature details)
 Net Capacity is available upon request
 ± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6E^A	LSF035 LSF040	3,900	1,000	-	-	1	685	1,164
6	CEL0045*±6E^A	LSF040 LSF047	5,300	1,600	-	-	1	641	1,088
6	CEL0065*±6E^A	LSF065	7,200	2,100	-	-	2	1,371	2,329
6	CEL0080*±6E^A	LSF075	8,400	2,500	-	-	2	1,371	2,329
6	CEL0100*±6E^A	LSF090	9,900	2,900	-	-	2	1,281	2,176
6	CEL0130*±6E^A	LSF120	13,500	4,000	-	-	3	2,056	3,493
6	CEL0155*±6E^A	LSF140	16,000	4,700	-	-	3	1,922	3,265
6	CEL0170*±6E^A	LSF160	17,900	5,200	-	-	4	2,741	4,658
6	CEL0205*±6E^A	LSF180	20,100	5,900	-	-	4	2,562	4,353
6	CEL0240*±6E^A	LSF200	22,400	6,500	-	-	5	3,203	5,441
6	CEL0255*±6E^A	LSF240	26,900	7,900	-	-	6	4,112	6,986
6	CEL0310*±6E^A	LSF280	31,400	9,200	-	-	6	3,843	6,529
4	CEL0045*±4E^A	LFF041	4,500	1,300	-	-	1	667	1,132
4	CEL0070*±4E^A	LFF068	7,400	2,200	-	-	2	1,425	2,422
4	CEL0090*±4E^A	LFF080	8,800	2,600	-	-	2	1,332	2,263
4	CEL0135*±4E^A	LFF102	12,100	3,500	-	-	3	1,998	3,395
4	CEL0180*±4E^A	LFF136	16,300	4,700	-	-	4	2,664	4,527
4	CEL0220*±4E^A	LFF170	19,600	5,600	-	-	5	3,331	5,659
4	CEL0275*±4E^A	LFF204 LFF235	25,900	7,600	-	-	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	CO ₂ DX		Fan Data		
			Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts			
6	CEL0040*C6E^A	N/A	3,900	1,143	1	685	1,164
6	CEL0045*C6E^A	N/A	5,300	1,553	1	641	1,088
6	CEL0065*C6E^A	N/A	7,200	2,110	2	1,371	2,329
6	CEL0080*C6E^A	N/A	8,400	2,462	2	1,371	2,329
6	CEL0100*C6E^A	N/A	9,900	2,901	2	1,281	2,176
6	CEL0130*C6E^A	N/A	13,500	3,956	3	2,056	3,493
6	CEL0155*C6E^A	N/A	16,000	4,689	3	1,922	3,265
6	CEL0170*C6E^A	N/A	17,900	5,246	4	2,741	4,657
6	CEL0205*C6E^A	N/A	20,100	5,891	4	2,562	4,353
6	CEL0240*C6E^A	N/A	22,400	6,565	5	3,203	5,441
6	CEL0255*C6E^A	N/A	26,900	7,884	6	4,112	6,986
6	CEL0310*C6E^A	N/A	31,400	9,202	6	3,843	6,529
4	CEL0045*C4E^A	N/A	4,500	1,319	1	667	1,132
4	CEL0070*C4E^A	N/A	7,400	2,169	2	1,425	2,422
4	CEL0090*C4E^A	N/A	8,800	2,579	2	1,332	2,263
4	CEL0135*C4E^A	N/A	12,100	3,546	3	1,998	3,395
4	CEL0180*C4E^A	N/A	16,300	4,777	4	2,664	4,527
4	CEL0220*C4E^A	N/A	19,600	5,744	5	3,331	5,659
4	CEL0275*C4E^A	N/A	25,900	7,591	6	3,997	6,790

Notes:
¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov
 * = Electrical Code Designator (see Nomenclature details)
 ^ = Motor Code Designator (see Nomenclature details)
 Net Capacity is available upon request

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	R454A			R454C			Fan Data		
		Application Capacity ¹			Application Capacity ¹					
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum	10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum	No. of Fans	CFM	m ³ H
		BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
6	CELO040*Y6E^A	3,600	1,055	51	3,100	909	49	1	617	1,048
6	CELO045*Y6E^A	4,900	1,436	54	4,200	1,231	52	1	576	979
6	CELO065*Y6E^A	6,600	1,934	60	5,700	1,671	57	2	1,234	2,096
6	CELO080*Y6E^A	7,700	2,257	60	6,600	1,934	57	2	1,234	2,096
6	CELO100*Y6E^A	9,100	2,667	66	7,800	2,286	64	2	1,153	1,959
6	CELO130*Y6E^A	12,400	3,634	69	10,600	3,107	66	3	1,850	3,144
6	CELO155*Y6E^A	14,700	4,308	85	12,600	3,693	82	3	1,729	2,938
6	CELO170*Y6E^A	16,500	4,836	84	14,100	4,132	80	4	2,467	4,192
6	CELO205*Y6E^A	18,500	5,422	96	15,800	4,631	92	4	2,306	3,918
6	CELO240*Y6E^A	20,600	6,038	107	17,700	5,188	102	5	2,882	4,897
6	CELO255*Y6E^A	24,800	7,268	101	21,200	6,213	97	6	3,701	6,288
6	CELO310*Y6E^A	28,900	8,470	118	24,800	7,268	113	6	2,459	5,876
4	CELO045*Y4E^A	4,100	1,202	55	3,500	1,026	52	1	600	1,019
4	CELO070*Y4E^A	6,800	1,993	60	5,800	1,700	57	2	1,283	2,180
4	CELO090*Y4E^A	8,100	2,374	67	6,900	2,022	64	2	1,199	2,037
4	CELO135*Y4E^A	11,200	3,283	84	9,500	2,784	81	3	1,799	3,056
4	CELO180*Y4E^A	15,000	4,396	96	12,900	3,781	92	4	2,398	4,074
4	CELO220*Y4E^A	18,100	5,305	107	15,500	4,543	102	5	2,998	5,093
4	CELO275*Y4E^A	23,900	7,005	118	20,400	5,979	113	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

		R455A					
		Application Capacity ¹			Fan Data		
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum			
FPI	New Model	BTUH	Watts	Sq. Ft.	No. of Fans	CFM	m ³ H
6	CEL0040*Y6E^A	3,500	1,026	33	1	617	1,048
6	CEL0045*Y6E^A	4,800	1,407	35	1	576	979
6	CEL0065*Y6E^A	6,500	1,905	39	2	1,234	2,096
6	CEL0080*Y6E^A	7,600	2,227	39	2	1,234	2,096
6	CEL0100*Y6E^A	8,900	2,608	43	2	1,153	1,959
6	CEL0130*Y6E^A	12,200	3,576	45	3	1,850	3,144
6	CEL0155*Y6E^A	14,400	4,220	55	3	1,729	2,938
6	CEL0170*Y6E^A	16,200	4,748	54	4	2,467	4,192
6	CEL0205*Y6E^A	18,100	5,305	62	4	2,306	3,918
6	CEL0240*Y6E^A	20,200	5,920	69	5	2,882	4,897
6	CEL0255*Y6E^A	24,300	7,122	66	6	3,701	6,288
6	CEL0310*Y6E^A	28,300	8,294	77	6	2,459	5,876
4	CEL0045*Y4E^A	4,100	1,202	40	1	600	1,019
4	CEL0070*Y4E^A	6,700	1,964	43	2	1,283	2,180
4	CEL0090*Y4E^A	7,900	2,315	48	2	1,199	2,037
4	CEL0135*Y4E^A	10,900	3,195	55	3	1,799	3,056
4	CEL0180*Y4E^A	14,700	4,308	62	4	2,398	4,074
4	CEL0220*Y4E^A	17,700	5,188	69	5	2,998	5,093
4	CEL0275*Y4E^A	23,400	6,858	77	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 50 Hz (For PSC Motors) †

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6E^A	LSF035 LSF040	3,325	950	3,705	950	1	617	1,048
6	CEL0045*±6E^A	LSF040 LSF047	4,465	1,330	5,035	1,520	1	576	979
6	CEL0065*±6E^A	LSF065	6,175	1,805	6,840	1,995	2	1,234	2,096
6	CEL0080*±6E^A	LSF075	7,125	2,090	7,980	2,375	2	1,234	2,096
6	CEL0100*±6E^A	LSF090	8,550	2,470	9,405	2,755	2	1,153	1,959
6	CEL0130*±6E^A	LSF120	11,400	3,325	12,825	3,800	3	1,850	3,144
6	CEL0155*±6E^A	LSF140	13,300	3,895	15,200	4,465	3	1,729	2,938
6	CEL0170*±6E^A	LSF160	15,200	4,465	17,005	4,940	4	2,467	4,192
6	CEL0205*±6E^A	LSF180	17,100	5,035	19,095	5,605	4	2,306	3,918
6	CEL0240*±6E^A	LSF200	19,000	5,605	21,660	6,270	5	2,882	4,897
6	CEL0255*±6E^A	LSF240	22,800	6,650	25,555	7,505	6	3,701	6,288
6	CEL0310*±6E^A	LSF280	26,600	7,790	29,830	8,740	6	2,459	5,876
4	CEL0045*±4E^A	LFF041	3,895	1,140	4,275	1,235	1	600	1,019
4	CEL0070*±4E^A	LFF068	6,460	1,900	7,030	2,090	2	1,283	2,180
4	CEL0090*±4E^A	LFF080	7,600	2,185	8,360	2,470	2	1,199	2,037
4	CEL0135*±4E^A	LFF102	9,690	2,850	12,160	3,515	3	1,799	3,056
4	CEL0180*±4E^A	LFF136	12,920	3,800	16,435	4,750	4	2,398	4,074
4	CEL0220*±4E^A	LFF170	16,150	4,750	18,525	5,320	5	2,998	5,093
4	CEL0275*±4E^A	LFF204 LFF235	22,325	6,555	24,605	7,220	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

† = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6E^A	LSF035 LSF040	3,705	950	-	-	1	617	1,048
6	CEL0045*±6E^A	LSF040 LSF047	5,035	1,520	-	-	1	576	979
6	CEL0065*±6E^A	LSF065	6,840	1,995	-	-	2	1,234	2,096
6	CEL0080*±6E^A	LSF075	7,980	2,375	-	-	2	1,234	2,096
6	CEL0100*±6E^A	LSF090	9,405	2,755	-	-	2	1,153	1,959
6	CEL0130*±6E^A	LSF120	12,825	3,800	-	-	3	1,850	3,144
6	CEL0155*±6E^A	LSF140	15,200	4,465	-	-	3	1,729	2,938
6	CEL0170*±6E^A	LSF160	17,005	4,940	-	-	4	2,467	4,192
6	CEL0205*±6E^A	LSF180	19,095	5,605	-	-	4	2,306	3,918
6	CEL0240*±6E^A	LSF200	21,280	6,175	-	-	5	2,882	4,897
6	CEL0255*±6E^A	LSF240	25,555	7,505	-	-	6	3,701	6,288
6	CEL0310*±6E^A	LSF280	29,830	8,740	-	-	6	2,459	5,876
4	CEL0045*±4E^A	LFF041	4,275	1,235	-	-	1	600	1,019
4	CEL0070*±4E^A	LFF068	7,030	2,090	-	-	2	1,283	2,180
4	CEL0090*±4E^A	LFF080	8,360	2,470	-	-	2	1,199	2,037
4	CEL0135*±4E^A	LFF102	11,495	3,325	-	-	3	1,799	3,056
4	CEL0180*±4E^A	LFF136	15,485	4,465	-	-	4	2,398	4,074
4	CEL0220*±4E^A	LFF170	18,620	5,320	-	-	5	2,998	5,093
4	CEL0275*±4E^A	LFF204 LFF235	24,605	7,220	-	-	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Electric Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 60 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	CO ₂ DX		Fan Data		
			Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts			
6	CEL0040*C6E^A	N/A	3,705	1,086	1	617	1,048
6	CEL0045*C6E^A	N/A	5,035	1,476	1	576	979
6	CEL0065*C6E^A	N/A	6,840	2,005	2	1,234	2,096
6	CEL0080*C6E^A	N/A	7,980	2,339	2	1,234	2,096
6	CEL0100*C6E^A	N/A	9,405	2,756	2	1,153	1,959
6	CEL0130*C6E^A	N/A	12,825	3,759	3	1,850	3,144
6	CEL0155*C6E^A	N/A	15,200	4,455	3	1,729	2,938
6	CEL0170*C6E^A	N/A	17,005	4,984	4	2,467	4,192
6	CEL0205*C6E^A	N/A	19,095	5,596	4	2,306	3,918
6	CEL0240*C6E^A	N/A	21,280	6,237	5	2,882	4,897
6	CEL0255*C6E^A	N/A	25,555	7,489	6	3,701	6,288
6	CEL0310*C6E^A	N/A	29,830	8,742	6	2,459	5,876
4	CEL0045*C4E^A	N/A	4,275	1,253	1	600	1,019
4	CEL0070*C4E^A	N/A	7,030	2,060	2	1,283	2,180
4	CEL0090*C4E^A	N/A	8,360	2,450	2	1,199	2,037
4	CEL0135*C4E^A	N/A	11,495	3,369	3	1,799	3,056
4	CEL0180*C4E^A	N/A	15,485	4,538	4	2,398	4,074
4	CEL0220*C4E^A	N/A	18,620	5,457	5	2,998	5,093
4	CEL0275*C4E^A	N/A	24,605	7,211	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

A2L PERFORMANCE DATA

Application Capacity: Medium Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 61 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	R454A			R454C			Fan Data		
		Application Capacity ¹			Application Capacity ¹					
		10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum	No. of Fans	CFM	m ³ H
		BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
6	CELO040*Y6E^A	4,400	1,290	51	3,700	1,084	49	1	685	1,164
6	CELO045*Y6E^A	5,900	1,729	54	5,100	1,495	52	1	641	1,088
6	CELO065*Y6E^A	8,100	2,374	60	6,900	2,022	57	2	1,371	2,329
6	CELO080*Y6E^A	9,300	2,726	60	8,100	2,374	57	2	1,371	2,329
6	CELO100*Y6E^A	11,000	3,224	66	9,400	2,755	64	2	1,281	2,176
6	CELO130*Y6E^A	15,100	4,426	69	12,900	3,781	66	3	2,056	3,493
6	CELO155*Y6E^A	17,800	5,217	85	15,300	4,484	82	3	1,922	3,265
6	CELO170*Y6E^A	20,000	5,862	84	17,100	5,012	80	4	2,741	4,658
6	CELO205*Y6E^A	22,400	6,565	96	19,200	5,627	92	4	2,562	4,353
6	CELO240*Y6E^A	25,000	7,327	107	21,400	6,272	102	5	3,203	5,441
6	CELO255*Y6E^A	30,000	8,792	101	25,600	7,503	97	6	4,112	6,986
6	CELO310*Y6E^A	35,100	10,287	118	30,000	8,792	113	6	3,843	6,529
4	CELO045*Y4E^A	5,100	1,495	55	4,300	1,260	52	1	667	1,132
4	CELO070*Y4E^A	8,300	2,433	60	7,000	2,052	57	2	1,425	2,422
4	CELO090*Y4E^A	9,800	2,872	67	8,400	2,462	64	2	1,332	2,263
4	CELO135*Y4E^A	13,500	3,957	84	11,500	3,370	81	3	1,998	3,395
4	CELO180*Y4E^A	18,200	5,334	96	15,500	4,543	92	4	2,664	4,527
4	CELO220*Y4E^A	21,900	6,419	107	18,700	5,481	102	5	3,331	5,659
4	CELO275*Y4E^A	28,900	8,470	118	24,700	7,239	113	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

† = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

A2L PERFORMANCE DATA

Application Capacity: Medium Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 61 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

		R455A					
		Application Capacity ¹			Fan Data		
		10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum			
FPI	New Model	BTUH	Watts	Sq. Ft.	No. of Fans	CFM	m ³ H
6	CEL0040*Y6E^A	4,300	1,260	33	1	685	1,164
6	CEL0045*Y6E^A	5,800	1,700	35	1	641	1,088
6	CEL0065*Y6E^A	7,800	2,286	39	2	1,371	2,329
6	CEL0080*Y6E^A	9,200	2,696	39	2	1,371	2,329
6	CEL0100*Y6E^A	10,800	3,165	43	2	1,281	2,176
6	CEL0130*Y6E^A	14,700	4,308	45	3	2,056	3,493
6	CEL0155*Y6E^A	17,500	5,129	55	3	1,922	3,265
6	CEL0170*Y6E^A	19,600	5,744	54	4	2,741	4,658
6	CEL0205*Y6E^A	22,000	6,448	62	4	2,562	4,353
6	CEL0240*Y6E^A	24,500	7,181	69	5	3,203	5,441
6	CEL0255*Y6E^A	29,400	8,617	66	6	4,112	6,986
6	CEL0310*Y6E^A	34,300	10,053	77	6	3,843	6,529
4	CEL0045*Y4E^A	4,900	1,436	40	1	667	1,132
4	CEL0070*Y4E^A	8,100	2,374	43	2	1,425	2,422
4	CEL0090*Y4E^A	9,700	2,843	48	2	1,332	2,263
4	CEL0135*Y4E^A	13,200	3,869	55	3	1,998	3,395
4	CEL0180*Y4E^A	17,800	5,217	62	4	2,664	4,527
4	CEL0220*Y4E^A	21,400	6,272	69	5	3,331	5,659
4	CEL0275*Y4E^A	28,300	8,294	77	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

† = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

A1 PERFORMANCE DATA

Application Capacity: Medium Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 61 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/25°F SST	6°C TD/-4°F SST	10°F TD/25°F SST	6°C TD/-4°F SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6E^A	LSF035 LSF040	4,000	1,200	4,500	1,300	1	685	1,164
6	CEL0045*±6E^A	LSF040 LSF047	5,400	1,550	6,100	1,750	1	641	1,088
6	CEL0065*±6E^A	LSF065	7,450	2,150	8,300	2,400	2	1,371	2,329
6	CEL0080*±6E^A	LSF075	8,650	2,500	9,650	2,800	2	1,371	2,329
6	CEL0100*±6E^A	LSF090	10,350	3,000	11,400	3,300	2	1,281	2,176
6	CEL0130*±6E^A	LSF120	13,800	4,000	15,500	4,500	3	2,056	3,493
6	CEL0155*±6E^A	LSF140	16,100	4,650	18,400	5,300	3	1,922	3,265
6	CEL0170*±6E^A	LSF160	18,400	5,300	20,600	5,950	4	2,741	4,658
6	CEL0205*±6E^A	LSF180	20,700	6,000	23,100	6,650	4	2,562	4,353
6	CEL0240*±6E^A	LSF200	23,000	6,650	25,750	7,450	5	3,203	5,441
6	CEL0255*±6E^A	LSF240	27,600	7,950	30,950	8,950	6	4,112	6,986
6	CEL0310*±6E^A	LSF280	32,200	9,300	36,100	10,400	6	3,843	6,529
4	CEL0045*±4E^A	LFF041	4,700	1,400	5,200	1,500	1	667	1,132
4	CEL0070*±4E^A	LFF068	7,800	2,250	8,500	2,450	2	1,425	2,422
4	CEL0090*±4E^A	LFF080	9,200	2,650	10,100	2,900	2	1,332	2,263
4	CEL0135*±4E^A	LFF102	11,750	3,400	13,050	3,800	3	1,998	3,395
4	CEL0180*±4E^A	LFF136	15,650	4,500	17,650	5,100	4	2,664	4,527
4	CEL0220*±4E^A	LFF170	19,550	5,650	21,850	6,300	5	3,331	5,659
4	CEL0275*±4E^A	LFF204 LFF235	27,000	7,800	29,800	8,600	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Medium Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 61 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/25°F SST	6°C TD/-4°F SST	10°F TD/25°F SST	6°C TD/-4°F SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6E^A	LSF035 LSF040	4,500	1,300	-	-	1	685	1,164
6	CEL0045*±6E^A	LSF040 LSF047	6,100	1,750	-	-	1	641	1,088
6	CEL0065*±6E^A	LSF065	8,300	2,400	-	-	2	1,371	2,329
6	CEL0080*±6E^A	LSF075	9,650	2,800	-	-	2	1,371	2,329
6	CEL0100*±6E^A	LSF090	11,400	3,300	-	-	2	1,281	2,176
6	CEL0130*±6E^A	LSF120	15,500	4,500	-	-	3	2,056	3,493
6	CEL0155*±6E^A	LSF140	18,400	5,300	-	-	3	1,922	3,265
6	CEL0170*±6E^A	LSF160	20,600	5,950	-	-	4	2,741	4,658
6	CEL0205*±6E^A	LSF180	23,100	6,650	-	-	4	2,562	4,353
6	CEL0240*±6E^A	LSF200	25,750	7,450	-	-	5	3,203	5,441
6	CEL0255*±6E^A	LSF240	30,950	8,950	-	-	6	4,112	6,986
6	CEL0310*±6E^A	LSF280	36,100	10,400	-	-	6	3,843	6,529
4	CEL0045*±4E^A	LFF041	5,200	1,500	-	-	1	667	1,132
4	CEL0070*±4E^A	LFF068	8,500	2,450	-	-	2	1,425	2,422
4	CEL0090*±4E^A	LFF080	10,100	2,900	-	-	2	1,332	2,263
4	CEL0135*±4E^A	LFF102	13,050	3,800	-	-	3	1,998	3,395
4	CEL0180*±4E^A	LFF136	17,650	5,100	-	-	4	2,664	4,527
4	CEL0220*±4E^A	LFF170	21,850	6,300	-	-	5	3,331	5,659
4	CEL0275*±4E^A	LFF204 LFF235	29,800	8,600	-	-	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Medium Temperature Electric Defrost- 60 Hz

Please consult AWEF table on page 61 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	CO ₂ DX		Fan Data		
			Application Capacity ¹				
			10°F TD/25°F SST	6°C TD/-4°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts			
6	CEL0040*C6E^A	N/A	4,500	1,319	1	685	1,164
6	CEL0045*C6E^A	N/A	6,100	1,788	1	641	1,089
6	CEL0065*C6E^A	N/A	8,300	2,432	2	1,371	2,329
6	CEL0080*C6E^A	N/A	9,650	2,828	2	1,371	2,329
6	CEL0100*C6E^A	N/A	11,400	3,341	2	1,281	2,176
6	CEL0130*C6E^A	N/A	15,500	4,543	3	2,056	3,493
6	CEL0155*C6E^A	N/A	18,400	5,393	3	1,922	3,265
6	CEL0170*C6E^A	N/A	20,600	6,037	4	2,741	4,657
6	CEL0205*C6E^A	N/A	23,100	6,770	4	2,562	4,353
6	CEL0240*C6E^A	N/A	25,750	7,547	5	3,203	5,442
6	CEL0255*C6E^A	N/A	30,950	9,071	6	4,112	6,986
6	CEL0310*C6E^A	N/A	36,100	10,580	6	3,843	6,529
4	CEL0045*C4E^A	N/A	5,200	1,524	1	641	1,089
4	CEL0070*C4E^A	N/A	8,500	2,491	2	1,425	2,421
4	CEL0090*C4E^A	N/A	10,100	2,960	2	1,332	2,263
4	CEL0135*C4E^A	N/A	13,050	3,825	3	1,998	3,395
4	CEL0180*C4E^A	N/A	17,650	5,173	4	2,664	4,526
4	CEL0220*C4E^A	N/A	21,850	6,404	5	3,331	5,659
4	CEL0275*C4E^A	N/A	29,800	8,734	6	3,997	6,791

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

SPECIFICATIONS

Electric Defrost- 60 Hz

FPI	New Model	HP	2-Speed EC Motor (Totally Enclosed)				Defrost Heaters-230V			Defrost Heaters-460V	
			208-230/1/60				Watts	230/1/60	230/3/60	Watts	460/1/60
			Amps	Watts	MCA	MOPD					
6	CEL0040*±6EMA	1/20	0.5	55	0.6	15	1,050	4.6	2.8	900	2.0
6	CEL0045*±6EMA	1/20	0.5	55	0.6	15	1,050	4.6	2.8	900	2.0
6	CEL0065*±6EMA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0080*±6EMA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0100*±6EMA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0130*±6EMA	1/20	1.5	165	1.6	15	3,150	13.7	8.5	2,700	5.9
6	CEL0155*±6EMA	1/20	1.5	165	1.6	15	3,150	13.7	8.5	2,700	5.9
6	CEL0170*±6EMA	1/20	2.0	220	2.1	15	4,200	18.3	11.4	3,600	7.8
6	CEL0205*±6EMA	1/20	2.0	220	2.1	15	4,200	18.3	11.4	3,600	7.8
6	CEL0240*±6EMA	1/20	2.5	275	2.6	15	5,250	22.8	14.2	4,500	9.8
6	CEL0255*±6EMA	1/20	3.0	330	3.1	15	6,300	27.4	17.1	5,400	11.7
6	CEL0310*±6EMA	1/20	3.0	330	3.1	15	6,300	27.4	17.1	5,400	11.7
4	CEL0045*±4EMA	1/20	0.5	55	0.6	15	1,050	4.6	2.8	900	2.0
4	CEL0070*±4EMA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
4	CEL0090*±4EMA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
4	CEL0135*±4EMA	1/20	1.5	165	1.6	15	3,150	13.7	8.5	2,700	5.9
4	CEL0180*±4EMA	1/20	2.0	220	2.1	15	4,200	18.3	11.4	3,600	7.8
4	CEL0220*±4EMA	1/20	2.5	275	2.6	15	5,250	22.8	14.2	4,500	9.8
4	CEL0275*±4EMA	1/20	3.0	330	3.1	15	6,300	27.4	17.1	5,400	11.7

FPI	New Model	HP	1-Speed EC Motor (Totally Enclosed)				Defrost Heaters-230V			Defrost Heaters-460V	
			208-230/1/60				Watts	230/1/60	230/3/60	Watts	460/1/60
			Amps	Watts	MCA	MOPD					
6	CEL0040*±6EEA	1/20	0.5	55	0.6	15	1,050	4.6	2.8	900	2.0
6	CEL0045*±6EEA	1/20	0.5	55	0.6	15	1,050	4.6	2.8	900	2.0
6	CEL0065*±6EEA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0080*±6EEA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0100*±6EEA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0130*±EEA	1/20	1.5	165	1.6	15	3,150	13.7	8.5	2,700	5.9
6	CEL0155*±6EMA	1/20	1.5	165	1.6	15	3,150	13.7	8.5	2,700	5.9
6	CEL0170*±6EMA	1/20	2.0	220	2.1	15	4,200	18.3	11.4	3,600	7.8
6	CEL0205*±6EMA	1/20	2.0	220	2.1	15	4,200	18.3	11.4	3,600	7.8
6	CEL0240*±6EMA	1/20	2.5	275	2.6	15	5,250	22.8	14.2	4,500	9.8
6	CEL0255*±6EMA	1/20	3.0	330	3.1	15	6,300	27.4	17.1	5,400	11.7
6	CEL0310*±6EMA	1/20	3.0	330	3.1	15	6,300	27.4	17.1	5,400	11.7
4	CEL0045*±4EEA	1/20	0.5	55	0.6	15	1,050	4.6	2.8	900	2.0
4	CEL0070*±4EEA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
4	CEL0090*±4EEA	1/20	1.0	110	1.1	15	2,100	9.1	5.7	1,800	3.9
4	CEL0135*±4EEA	1/20	1.5	165	1.6	15	3,150	13.7	8.5	2,700	5.9
4	CEL0180*±4EEA	1/20	2.0	220	2.1	15	4,200	18.3	11.4	3,600	7.8
4	CEL0220*±4EEA	1/20	2.5	275	2.6	15	5,250	22.8	14.2	4,500	9.8
4	CEL0275*±4EEA	1/20	3.0	330	3.1	15	6,300	27.4	17.1	5,400	11.7

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Electric Defrost- 60 Hz

FPI	New Model	HP	PSC Motor (Totally Enclosed)				Defrost Heaters-230V			Defrost Heaters-460V	
			208-230/1/60				Watts	230/1/60	230/3/60	Watts	460/1/60
			Amps	Watts	MCA	MOPD					
6	CEL0040*±6ECA	1/20	0.5	91	0.6	15	1,050	4.6	2.8	900	2.0
6	CEL0045*±6ECA	1/20	0.5	91	0.6	15	1,050	4.6	2.8	900	2.0
6	CEL0065*±6ECA	1/20	1.0	182	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0080*±6ECA	1/20	1.0	182	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0100*±6ECA	1/20	1.0	182	1.1	15	2,100	9.1	5.7	1,800	3.9
6	CEL0130*±6ECA	1/20	1.5	273	1.6	15	3,150	13.7	8.5	2,700	5.9
6	CEL0155*±6ECA	1/20	1.5	273	1.6	15	3,150	13.7	8.5	2,700	5.9
6	CEL0170*±6ECA	1/20	2.0	364	2.1	15	4,200	18.3	11.4	3,600	7.8
6	CEL0205*±6ECA	1/20	2.0	364	2.1	15	4,200	18.3	11.4	3,600	7.8
6	CEL0240*±6ECA	1/20	2.5	455	2.6	15	5,250	22.8	14.2	4,500	9.8
6	CEL0255*±6ECA	1/20	3.0	546	3.1	15	6,300	27.4	17.1	5,400	11.7
6	CEL0310*±6ECA	1/20	3.0	546	3.1	15	6,300	27.4	17.1	5,400	11.7
4	CEL0045*±4ECA	1/20	0.5	91	0.6	15	1,050	4.6	2.8	900	2.0
4	CEL0070*±4ECA	1/20	1.0	182	1.1	15	2,100	9.1	5.7	1,800	3.9
4	CEL0090*±4ECA	1/20	1.0	182	1.1	15	2,100	9.1	5.7	1,800	3.9
4	CEL0135*±4ECA	1/20	1.5	273	1.6	15	3,150	13.7	8.5	2,700	5.9
4	CEL0180*±4ECA	1/20	2.0	364	2.1	15	4,200	18.3	11.4	3,600	7.8
4	CEL0220*±4ECA	1/20	2.5	455	2.6	15	5,250	22.8	14.2	4,500	9.8
4	CEL0275*±4ECA	1/20	3.0	546	3.1	15	6,300	27.4	17.1	5,400	11.7

FPI	New Model	HP	PSC Motor (Totally Enclosed)				Defrost Heaters-230V			Defrost Heaters-460V	
			460/1/60				Watts	230/1/60	230/3/60	Watts	460/1/60
			Amps	Watts	MCA	MOPD					
6	CEL0040*±6ECA	1/20	0.4	117	0.5	15	1,050	4.6	2.8	900	2.0
6	CEL0045*±6ECA	1/20	0.4	117	0.5	15	1,050	4.6	2.8	900	2.0
6	CEL0065*±6ECA	1/20	0.8	234	0.9	15	2,100	9.1	5.7	1,800	3.9
6	CEL0080*±6ECA	1/20	0.8	234	0.9	15	2,100	9.1	5.7	1,800	3.9
6	CEL0100*±6ECA	1/20	0.8	234	0.9	15	2,100	9.1	5.7	1,800	3.9
6	CEL0130*±6ECA	1/20	1.2	351	1.3	15	3,150	13.7	8.5	2,700	5.9
6	CEL0155*±6ECA	1/20	1.2	351	1.3	15	3,150	13.7	8.5	2,700	5.9
6	CEL0170*±6ECA	1/20	1.6	468	1.7	15	4,200	18.3	11.4	3,600	7.8
6	CEL0205*±6ECA	1/20	1.6	468	1.7	15	4,200	18.3	11.4	3,600	7.8
6	CEL0240*±6ECA	1/20	2.0	585	2.1	15	5,250	22.8	14.2	4,500	9.8
6	CEL0255*±6ECA	1/20	2.4	702	2.5	15	6,300	27.4	17.1	5,400	11.7
6	CEL0310*±6ECA	1/20	2.4	702	2.5	15	6,300	27.4	17.1	5,400	11.7
4	CEL0045*±4ECA	1/20	0.4	117	0.5	15	1,050	4.6	2.8	900	2.0
4	CEL0070*±4ECA	1/20	0.8	234	0.9	15	2,100	9.1	5.7	1,800	3.9
4	CEL0090*±4ECA	1/20	0.8	234	0.9	15	2,100	9.1	5.7	1,800	3.9
4	CEL0135*±4ECA	1/20	1.2	351	1.3	15	3,150	13.7	8.5	2,700	5.9
4	CEL0180*±4ECA	1/20	1.6	468	1.7	15	4,200	18.3	11.4	3,600	7.8
4	CEL0220*±4ECA	1/20	2.0	585	2.1	15	5,250	22.8	14.2	4,500	9.8
4	CEL0275*±4ECA	1/20	2.4	702	2.5	15	6,300	27.4	17.1	5,400	11.7

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Electric Defrost- 50 Hz

FPI	New Model	HP	2-Speed EC Motor (Totally Enclosed)				Defrost Heaters	
			220/1/50				Watts	220/1/50 Total Amps
			Amps	Watts	MCA	MOPD		
6	CEL0040*±6EMA	1/20	0.5	55	0.6	15	960	4.4
6	CEL0045*±6EMA	1/20	0.5	55	0.6	15	960	4.4
6	CEL0065*±6EMA	1/20	1.0	110	1.1	15	1,920	8.7
6	CEL0080*±6EMA	1/20	1.0	110	1.1	15	1,920	8.7
6	CEL0100*±6EMA	1/20	1.0	110	1.1	15	1,920	8.7
6	CEL0130*±6EMA	1/20	1.5	165	1.6	15	2,880	13.1
6	CEL0155*±6EMA	1/20	1.5	165	1.6	15	2,880	13.1
6	CEL0170*±6EMA	1/20	2.0	220	2.1	15	3,845	17.5
6	CEL0205*±6EMA	1/20	2.0	220	2.1	15	3,845	17.5
6	CEL0240*±6EMA	1/20	2.5	275	2.6	15	4,805	21.8
6	CEL0255*±6EMA	1/20	3.0	330	3.1	15	5,765	26.2
6	CEL0310*±6EMA	1/20	3.0	330	3.1	15	5,765	26.2
4	CEL0045*±4EMA	1/20	0.5	55	0.6	15	960	4.4
4	CEL0070*±4EMA	1/20	1.0	110	1.1	15	1,920	8.7
4	CEL0090*±4EMA	1/20	1.0	110	1.1	15	1,920	8.7
4	CEL0135*±4EMA	1/20	1.5	165	1.6	15	2,880	13.1
4	CEL0180*±4EMA	1/20	2.0	220	2.1	15	3,845	17.5
4	CEL0220*±4EMA	1/20	2.5	275	2.6	15	4,805	21.8
4	CEL0275*±4EMA	1/20	3.0	330	3.1	15	5,765	26.2

FPI	New Model	HP	1-Speed EC Motor (Totally Enclosed)				Defrost Heaters	
			220/1/50				Watts	220/1/50 Total Amps
			Amps	Watts	MCA	MOPD		
6	CEL0040*±6EEA	1/20	0.5	59	0.6	15	960	4.4
6	CEL0045*±6EEA	1/20	0.5	59	0.6	15	960	4.4
6	CEL0065*±6EEA	1/20	1.0	118	1.1	15	1,920	8.7
6	CEL0080*±6EEA	1/20	1.0	118	1.1	15	1,920	8.7
6	CEL0100*±6EEA	1/20	1.0	118	1.1	15	1,920	8.7
6	CEL0130*±6EEA	1/20	1.5	177	1.6	15	2,880	13.1
6	CEL0155*±6EEA	1/20	1.5	177	1.6	15	2,880	13.1
6	CEL0170*±6EEA	1/20	2.0	236	2.1	15	3,845	17.5
6	CEL0205*±6EEA	1/20	2.0	236	2.1	15	3,845	17.5
6	CEL0240*±6EEA	1/20	2.5	295	2.6	15	4,805	21.8
6	CEL0255*±6EEA	1/20	3.0	354	3.1	15	5,765	26.2
6	CEL0310*±6EEA	1/20	3.0	354	3.1	15	5,765	26.2
4	CEL0045*±4EEA	1/20	0.5	59	0.6	15	960	4.4
4	CEL0070*±4EEA	1/20	1.0	118	1.1	15	1,920	8.7
4	CEL0090*±4EEA	1/20	1.0	118	1.1	15	1,920	8.7
4	CEL0135*±4EEA	1/20	1.5	177	1.6	15	2,880	13.1
4	CEL0180*±4EEA	1/20	2.0	236	2.1	15	3,845	17.5
4	CEL0220*±4EEA	1/20	2.5	295	2.6	15	4,805	21.8
4	CEL0275*±4EEA	1/20	3.0	354	3.1	15	5,765	26.2

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Electric Defrost- 50 Hz

FPI	New Model	HP	PSC Motor (Totally Enclosed)				Defrost Heaters	
			220/1/50				Watts	220/1/50
			Amps	Watts	MCA	MOPD		Total Amps
6	CEL0040*±6ECA	1/20	0.5	65	0.6	15	960	4.4
6	CEL0045*±6ECA	1/20	0.5	65	0.6	15	960	4.4
6	CEL0065*±6ECA	1/20	1.0	130	1.1	15	1,920	8.7
6	CEL0080*±6ECA	1/20	1.0	130	1.1	15	1,920	8.7
6	CEL0100*±6ECA	1/20	1.0	130	1.1	15	1,920	8.7
6	CEL0130*±6ECA	1/20	1.5	195	1.6	15	2,880	13.1
6	CEL0155*±6ECA	1/20	1.5	195	1.6	15	2,880	13.1
6	CEL0170*±6ECA	1/20	2.0	260	2.1	15	3,845	17.5
6	CEL0205*±6ECA	1/20	2.0	260	2.1	15	3,845	17.5
6	CEL0240*±6ECA	1/20	2.5	325	2.6	15	4,805	21.8
6	CEL0255*±6ECA	1/20	3.0	390	3.1	15	5,765	26.2
6	CEL0310*±6ECA	1/20	3.0	390	3.1	15	5,765	26.2
4	CEL0045*±4ECA	1/20	0.5	65	0.6	15	960	4.4
4	CEL0070*±4ECA	1/20	1.0	130	1.1	15	1,920	8.7
4	CEL0090*±4ECA	1/20	1.0	130	1.1	15	1,920	8.7
4	CEL0135*±4ECA	1/20	1.5	195	1.6	15	2,880	13.1
4	CEL0180*±4ECA	1/20	2.0	260	2.1	15	3,845	17.5
4	CEL0220*±4ECA	1/20	2.5	325	2.6	15	4,805	21.8
4	CEL0275*±4ECA	1/20	3.0	390	3.1	15	5,765	26.2

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	R454A			R454C			Fan Data		
		Application Capacity ¹			Application Capacity ¹					
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum**	10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum**	No. of Fans	CFM	m ³ H
		BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
6	CELO040*Y6H^A	3,800	1,114	51	3,200	938	49	1	685	1,164
6	CELO045*Y6H^A	5,100	1,495	54	4,400	1,290	52	1	641	1,088
6	CELO065*Y6H^A	7,000	2,052	60	6,000	1,758	57	2	1,371	2,329
6	CELO080*Y6H^A	8,100	2,374	60	7,000	2,052	57	2	1,371	2,329
6	CELO100*Y6H^A	9,600	2,814	66	8,200	2,403	64	2	1,281	2,176
6	CELO130*Y6H^A	13,100	3,839	69	11,200	3,283	66	3	2,056	3,493
6	CELO155*Y6H^A	15,500	4,543	85	13,300	3,898	82	3	1,922	3,265
6	CELO170*Y6H^A	17,400	5,100	84	14,900	4,367	80	4	2,741	4,658
6	CELO205*Y6H^A	19,500	5,715	96	16,700	4,894	92	4	2,562	4,353
6	CELO240*Y6H^A	21,700	6,360	107	18,600	5,451	102	5	3,203	5,441
6	CELO255*Y6H^A	26,100	7,649	101	22,300	6,536	97	6	4,112	6,986
6	CELO310*Y6H^A	30,500	8,939	118	26,100	7,649	113	6	3,843	6,529
4	CELO045*Y4H^A	4,400	1,290	55	3,700	1,084	52	1	667	1,132
4	CELO070*Y4H^A	7,200	2,110	60	6,100	1,788	57	2	1,425	2,422
4	CELO090*Y4H^A	8,500	2,491	67	7,300	2,140	64	2	1,332	2,263
4	CELO135*Y4H^A	11,700	3,429	84	10,000	2,931	81	3	1,998	3,395
4	CELO180*Y4H^A	15,800	4,631	96	13,500	3,957	92	4	2,664	4,527
4	CELO220*Y4H^A	19,000	5,569	107	16,300	4,777	102	5	3,331	5,659
4	CELO275*Y4H^A	25,100	7,356	118	21,500	6,301	113	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

** = With Electric Drainpan. For Hot Gas Drainpan, refer to The HUB/call AE for updated Room Area Minimum

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

		R455A					
		Application Capacity ¹			Fan Data		
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum**			
FPI	New Model	BTUH	Watts	Sq. Ft.	No. of Fans	CFM	m ³ H
6	CELO040*Y6H^A	3,700	1,084	33	1	685	1,164
6	CELO045*Y6H^A	5,000	1,465	35	1	641	1,088
6	CELO065*Y6H^A	6,800	1,993	39	2	1,371	2,329
6	CELO080*Y6H^A	8,000	2,345	39	2	1,371	2,329
6	CELO100*Y6H^A	9,400	2,755	43	2	1,281	2,176
6	CELO130*Y6H^A	12,800	3,751	45	3	2,056	3,493
6	CELO155*Y6H^A	15,200	4,455	55	3	1,922	3,265
6	CELO170*Y6H^A	17,000	4,982	54	4	2,741	4,658
6	CELO205*Y6H^A	19,100	5,598	62	4	2,562	4,353
6	CELO240*Y6H^A	21,300	6,243	69	5	3,203	5,441
6	CELO255*Y6H^A	25,600	7,503	66	6	4,112	6,986
6	CELO310*Y6H^A	29,800	8,734	77	6	3,843	6,529
4	CELO045*Y4H^A	4,300	1,260	40	1	667	1,132
4	CELO070*Y4H^A	7,000	2,052	43	2	1,425	2,422
4	CELO090*Y4H^A	8,400	2,462	48	2	1,332	2,263
4	CELO135*Y4H^A	11,500	3,370	55	3	1,998	3,395
4	CELO180*Y4H^A	15,500	4,543	62	4	2,664	4,527
4	CELO220*Y4H^A	18,600	5,451	69	5	3,331	5,659
4	CELO275*Y4H^A	24,600	7,210	77	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

** = With Electric Drainpan. For Hot Gas Drainpan, refer to The HUB/call AE for updated Room Area Minimum

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6H^A	LSH035 LSH040	3,500	1,000	3,900	1,000	1	685	1,164
6	CEL0045*±6H^A	LSH040 LSH047	4,700	1,400	5,300	1,600	1	641	1,088
6	CEL0065*±6H^A	LSH065	6,500	1,900	7,200	2,100	2	1,371	2,329
6	CEL0080*±6H^A	LSH075	7,500	2,200	8,400	2,500	2	1,371	2,329
6	CEL0100*±6H^A	LSH090	9,000	2,600	9,900	2,900	2	1,281	2,176
6	CEL0130*±6H^A	LSH120	12,000	3,500	13,500	4,000	3	2,056	3,493
6	CEL0155*±6H^A	LSH140	14,000	4,100	16,000	4,700	3	1,922	3,265
6	CEL0170*±6H^A	LSH160	16,000	4,700	17,900	5,200	4	2,741	4,658
6	CEL0205*±6H^A	LSH180	18,000	5,300	20,100	5,900	4	2,562	4,353
6	CEL0240*±6H^A	LSH200	20,000	5,900	22,800	6,600	5	3,203	5,441
6	CEL0255*±6H^A	LSH240	24,000	7,000	26,900	7,900	6	4,112	6,986
6	CEL0310*±6H^A	LSH280	28,000	8,200	31,400	9,200	6	3,843	6,529
4	CEL0045*±4H^A	LSH041	4,100	1,200	4,500	1,300	1	667	1,132
4	CEL0070*±4H^A	LSH068	6,800	2,000	7,400	2,200	2	1,425	2,422
4	CEL0090*±4H^A	LSH080	8,000	2,300	8,800	2,600	2	1,332	2,263
4	CEL0135*±4H^A	LSH102	10,200	3,000	12,800	3,700	3	1,998	3,395
4	CEL0180*±4H^A	LSH136	13,600	4,000	17,300	5,000	4	2,664	4,527
4	CEL0220*±4H^A	LSH170	17,000	5,000	19,500	5,600	5	3,331	5,659
4	CEL0275*±4H^A	LSH204 LSH235	23,500	6,900	25,900	7,600	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6H^A	LSH035 LSH040	3,900	1,000	-	-	1	685	1,164
6	CEL0045*±6H^A	LSH040 LSH047	5,300	1,600	-	-	1	641	1,088
6	CEL0065*±6H^A	LSH065	7,200	2,100	-	-	2	1,371	2,329
6	CEL0080*±6H^A	LSH075	8,400	2,500	-	-	2	1,371	2,329
6	CEL0100*±6H^A	LSH090	9,900	2,900	-	-	2	1,281	2,176
6	CEL0130*±6H^A	LSH120	13,500	4,000	-	-	3	2,056	3,493
6	CEL0155*±6H^A	LSH140	16,000	4,700	-	-	3	1,922	3,265
6	CEL0170*±6H^A	LSH160	17,900	5,200	-	-	4	2,741	4,658
6	CEL0205*±6H^A	LSH180	20,100	5,900	-	-	4	2,562	4,353
6	CEL0240*±6H^A	LSH200	22,400	6,500	-	-	5	3,203	5,441
6	CEL0255*±6H^A	LSH240	26,900	7,900	-	-	6	4,112	6,986
6	CEL0310*±6H^A	LSH280	31,400	9,200	-	-	6	3,843	6,529
4	CEL0045*±4H^A	LSH041	4,500	1,300	-	-	1	667	1,132
4	CEL0070*±4H^A	LSH068	7,400	2,200	-	-	2	1,425	2,422
4	CEL0090*±4H^A	LSH080	8,800	2,600	-	-	2	1,332	2,263
4	CEL0135*±4H^A	LSH102	12,100	3,500	-	-	3	1,998	3,395
4	CEL0180*±4H^A	LSH136	16,300	4,700	-	-	4	2,664	4,527
4	CEL0220*±4H^A	LSH170	19,600	5,500	-	-	5	3,331	5,659
4	CEL0275*±4H^A	LSH204 LSH235	25,900	7,600	-	-	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

± = Y/S (see Nomenclature details)

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	R454A			R454C			Fan Data		
		Application Capacity ¹			Application Capacity ¹					
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum ^{**}	10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum ^{**}	No. of Fans	CFM	m ³ H
		BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
6	CEL0040*Y6H^A	3,563	1,044	51	3,032	889	49	1	617	1,048
6	CEL0045*Y6H^A	4,167	1,221	54	3,449	1,011	52	1	576	979
6	CEL0065*Y6H^A	7,267	2,130	60	6,091	1,785	57	2	1,234	2,096
6	CEL0080*Y6H^A	7,267	2,130	60	6,091	1,785	57	2	1,234	2,096
6	CEL0100*Y6H^A	8,960	2,626	66	7,961	2,333	64	2	1,153	1,959
6	CEL0130*Y6H^A	10,908	3,197	69	9,547	2,798	66	3	1,850	3,144
6	CEL0155*Y6H^A	13,113	3,843	85	11,613	3,403	82	3	1,729	2,938
6	CEL0170*Y6H^A	14,384	4,216	84	12,078	3,540	80	4	2,467	4,192
6	CEL0205*Y6H^A	17,372	5,091	96	14,866	4,357	92	4	2,306	3,918
6	CEL0240*Y6H^A	20,960	6,143	107	17,329	5,079	102	5	2,882	4,897
6	CEL0255*Y6H^A	21,846	6,403	101	18,464	5,411	97	6	3,701	6,288
6	CEL0310*Y6H^A	21,823	6,396	118	19,212	5,631	113	6	2,459	5,876
4	CEL0045*Y4H^A	3,404	998	55	2,872	842	52	1	600	1,019
4	CEL0070*Y4H^A	5,841	1,712	60	4,972	1,457	57	2	1,283	2,180
4	CEL0090*Y4H^A	7,138	2,092	67	6,436	1,886	64	2	1,199	2,037
4	CEL0135*Y4H^A	10,916	3,199	84	9,516	2,789	81	3	1,799	3,056
4	CEL0180*Y4H^A	14,696	4,307	96	12,777	3,745	92	4	2,398	4,074
4	CEL0220*Y4H^A	17,799	5,217	107	15,039	4,408	102	5	2,998	5,093
4	CEL0275*Y4H^A	22,132	6,487	118	19,462	5,704	113	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

** = With Electric Drainpan. For Hot Gas Drainpan, refer to The HUB/call AE for updated Room Area Minimum

A2L PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

		R455A					
		Application Capacity ¹			Fan Data		
		10°F TD/-20°F SST	6°C TD/-29°C SST	Room Area Minimum			
FPI	New Model	BTUH	Watts	Sq. Ft.	No. of Fans	CFM	m ³ H
6	CEL0040*Y6H^A	3,670	1,076	33	1	617	1,048
6	CEL0045*Y6H^A	4,292	1,258	35	1	576	979
6	CEL0065*Y6H^A	7,485	2,194	39	2	1,234	2,096
6	CEL0080*Y6H^A	7,485	2,194	39	2	1,234	2,096
6	CEL0100*Y6H^A	9,229	2,705	43	2	1,153	1,959
6	CEL0130*Y6H^A	11,235	3,293	45	3	1,850	3,144
6	CEL0155*Y6H^A	13,507	3,959	55	3	1,729	2,938
6	CEL0170*Y6H^A	14,816	4,342	54	4	2,467	4,192
6	CEL0205*Y6H^A	17,893	5,244	62	4	2,306	3,918
6	CEL0240*Y6H^A	21,589	6,327	69	5	2,882	4,897
6	CEL0255*Y6H^A	22,502	6,595	66	6	3,701	6,288
6	CEL0310*Y6H^A	22,478	6,588	77	6	2,459	5,876
4	CEL0045*Y4H^A	3,506	1,027	40	1	600	1,019
4	CEL0070*Y4H^A	6,016	1,763	43	2	1,283	2,180
4	CEL0090*Y4H^A	7,352	2,155	48	2	1,199	2,037
4	CEL0135*Y4H^A	11,243	3,295	55	3	1,799	3,056
4	CEL0180*Y4H^A	15,137	4,436	62	4	2,398	4,074
4	CEL0220*Y4H^A	18,333	5,373	69	5	2,998	5,093
4	CEL0275*Y4H^A	22,796	6,681	77	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

** = With Electric Drainpan. For Hot Gas Drainpan, refer to The HUB/call AE for updated Room Area Minimum

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6H^A	LSH035 LSH040	3,325	950	3,705	950	1	617	1,048
6	CEL0045*±6H^A	LSH040 LSH047	4,465	1,330	5,035	1,520	1	576	979
6	CEL0065*±6H^A	LSH065	6,175	1,805	6,840	1,995	2	1,234	2,096
6	CEL0080*±6H^A	LSH075	7,125	2,090	7,980	2,375	2	1,234	2,096
6	CEL0100*±6H^A	LSH090	8,550	2,470	9,405	2,755	2	1,153	1,959
6	CEL0130*±6H^A	LSH120	11,400	3,325	12,825	3,800	3	1,850	3,144
6	CEL0155*±6H^A	LSH140	13,300	3,895	15,200	4,465	3	1,729	2,938
6	CEL0170*±6H^A	LSH160	15,200	4,465	17,005	4,940	4	2,467	4,192
6	CEL0205*±6H^A	LSH180	17,100	5,035	19,095	5,605	4	2,306	3,918
6	CEL0240*±6H^A	LSH200	19,000	5,605	21,660	6,270	5	2,882	4,897
6	CEL0255*±6H^A	LSH240	22,800	6,650	25,555	7,505	6	3,701	6,288
6	CEL0310*±6H^A	LSH280	26,600	7,790	29,830	8,740	6	2,459	5,876
4	CEL0045*±4H^A	LSH041	3,895	1,140	4,275	1,235	1	600	1,019
4	CEL0070*±4H^A	LSH068	6,460	1,900	7,030	2,090	2	1,283	2,180
4	CEL0090*±4H^A	LSH080	7,600	2,185	8,360	2,470	2	1,199	2,037
4	CEL0135*±4H^A	LSH102	9,690	2,850	12,160	3,515	3	1,799	3,056
4	CEL0180*±4H^A	LSH136	12,920	3,800	16,435	4,750	4	2,398	4,074
4	CEL0220*±4H^A	LSH170	16,150	4,750	18,525	5,320	5	2,998	5,093
4	CEL0275*±4H^A	LSH204 LSH235	22,325	6,555	24,605	7,220	6	3,597	6,111

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

[†] = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Low Temperature Hot Gas Defrost- 50 Hz (For PSC Motors)[†]

Please consult AWEF table on page 62 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/-20°F SST	6°C TD/-29°C SST	10°F TD/-20°F SST	6°C TD/-29°C SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6H^A	LSH035 LSH040	3,705	950	-	-	1	617	1,048
6	CEL0045*±6H^A	LSH040 LSH047	5,035	1,520	-	-	1	576	979
6	CEL0065*±6H^A	LSH065	6,840	1,995	-	-	2	1,234	2,096
6	CEL0080*±6H^A	LSH075	7,980	2,375	-	-	2	1,234	2,096
6	CEL0100*±6H^A	LSH090	9,405	2,755	-	-	2	1,153	1,959
6	CEL0130*±6H^A	LSH120	12,825	3,800	-	-	3	1,850	3,144
6	CEL0155*±6H^A	LSH140	15,200	4,465	-	-	3	1,729	2,938
6	CEL0170*±6H^A	LSH160	17,005	4,940	-	-	4	2,467	4,192
6	CEL0205*±6H^A	LSH180	19,095	5,605	-	-	4	2,306	3,918
6	CEL0240*±6H^A	LSH200	21,280	6,175	-	-	5	2,882	4,897
6	CEL0255*±6H^A	LSH240	25,555	7,505	-	-	6	3,701	6,288
6	CEL0310*±6H^A	LSH280	29,830	8,740	-	-	6	2,459	5,876
4	CEL0045*±4H^A	LSH041	4,275	1,235	-	-	1	600	1,019
4	CEL0070*±4H^A	LSH068	7,030	2,090	-	-	2	1,283	2,180
4	CEL0090*±4H^A	LSH080	8,360	2,470	-	-	2	1,199	2,037
4	CEL0135*±4H^A	LSH102	11,495	3,325	-	-	3	1,799	3,056
4	CEL0180*±4H^A	LSH136	15,485	4,465	-	-	4	2,398	4,074
4	CEL0220*±4H^A	LSH170	18,620	5,225	-	-	5	2,998	5,093
4	CEL0275*±4H^A	LSH204 LSH235	24,605	7,220	-	-	6	3,597	6,111

Notes:
¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov
* = Electrical Code Designator (see Nomenclature details)
^ = Motor Code Designator (see Nomenclature details)
Net Capacity is available upon request
† = For 1-speed and 2-speed EC motors, use 60 Hz capacity and airflow values. (units with EC motors operating at 50 Hz will not see a reduction in performance due to the electronic control of the motor)
± = Y/S (see Nomenclature details)

A2L PERFORMANCE DATA

Application Capacity: Medium Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 63 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	R454A			R454C			Fan Data		
		Application Capacity ¹			Application Capacity ¹					
		10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum**	10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum**	No. of Fans	CFM	m ³ H
		BTUH	Watts	Sq. Ft.	BTUH	Watts	Sq. Ft.			
6	CEL0040*Y6H^A	4,400	1,290	51	3,700	1,084	49	1	685	1,164
6	CEL0045*Y6H^A	5,900	1,729	54	5,100	1,495	52	1	641	1,088
6	CEL0065*Y6H^A	8,100	2,374	60	6,900	2,022	57	2	1,371	2,329
6	CEL0080*Y6H^A	9,300	2,726	60	8,100	2,374	57	2	1,371	2,329
6	CEL0100*Y6H^A	11,000	3,224	66	9,400	2,755	64	2	1,281	2,176
6	CEL0130*Y6H^A	15,100	4,426	69	12,900	3,781	66	3	2,056	3,493
6	CEL0155*Y6H^A	17,800	5,217	85	15,300	4,484	82	3	1,922	3,265
6	CEL0170*Y6H^A	20,000	5,862	84	17,100	5,012	80	4	2,741	4,658
6	CEL0205*Y6H^A	22,400	6,565	96	19,200	5,627	92	4	2,562	4,353
6	CEL0240*Y6H^A	25,000	7,327	107	21,400	6,272	102	5	3,203	5,441
6	CEL0255*Y6H^A	30,000	8,792	101	25,600	7,503	97	6	4,112	6,986
6	CEL0310*Y6H^A	35,100	10,287	118	30,000	8,792	113	6	3,843	6,529
4	CEL0045*Y4H^A	5,100	1,495	55	4,300	1,260	52	1	667	1,132
4	CEL0070*Y4H^A	8,300	2,433	60	7,000	2,052	57	2	1,425	2,422
4	CEL0090*Y4H^A	9,800	2,872	67	8,400	2,462	64	2	1,332	2,263
4	CEL0135*Y4H^A	13,500	3,957	84	11,500	3,370	81	3	1,998	3,395
4	CEL0180*Y4H^A	18,200	5,334	96	15,500	4,543	92	4	2,664	4,527
4	CEL0220*Y4H^A	21,900	6,419	107	18,700	5,481	102	5	3,331	5,659
4	CEL0275*Y4H^A	28,900	8,470	118	24,700	7,239	113	6	3,997	6,790

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

** = With Electric Drainpan. For Hot Gas Drainpan, refer to The HUB/call AE for updated Room Area Minimum

A2L PERFORMANCE DATA

Application Capacity: Medium Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 63 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

		R455A					
		Application Capacity ¹			Fan Data		
		10°F TD/25°F SST	6°C TD/-4°C SST	Room Area Minimum ^{**}			
FPI	New Model	BTUH	Watts	Sq. Ft.	No. of Fans	CFM	m ³ H
6	CEL0040*Y6H^A	4,300	1,260	33	1	685	1,164
6	CEL0045*Y6H^A	5,800	1,700	35	1	641	1,088
6	CEL0065*Y6H^A	7,800	2,286	39	2	1,371	2,329
6	CEL0080*Y6H^A	9,200	2,696	39	2	1,371	2,329
6	CEL0100*Y6H^A	10,800	3,165	43	2	1,281	2,176
6	CEL0130*Y6H^A	14,700	4,308	45	3	2,056	3,493
6	CEL0155*Y6H^A	17,500	5,129	55	3	1,922	3,265
6	CEL0170*Y6H^A	19,600	5,744	54	4	2,741	4,658
6	CELO205*Y6H^A	22,000	6,448	62	4	2,562	4,353
6	CELO240*Y6H^A	24,500	7,181	69	5	3,203	5,441
6	CELO255*Y6H^A	29,400	8,617	66	6	4,112	6,986
6	CELO310*Y6H^A	34,300	10,053	77	6	3,843	6,529
4	CEL0045*Y4H^A	4,900	1,436	40	1	667	1,132
4	CEL0070*Y4H^A	8,100	2,374	43	2	1,425	2,422
4	CEL0090*Y4H^A	9,700	2,843	48	2	1,332	2,263
4	CEL0135*Y4H^A	13,200	3,869	55	3	1,998	3,395
4	CEL0180*Y4H^A	17,800	5,217	62	4	2,664	4,527
4	CELO220*Y4H^A	21,400	6,272	69	5	3,331	5,659
4	CELO275*Y4H^A	28,300	8,294	77	6	3,997	6,790

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

** = With Electric Drainpan. For Hot Gas Drainpan, refer to The HUB/call AE for updated Room Area Minimum

A1 PERFORMANCE DATA

Application Capacity: Medium Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 63 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-404A/R-507A		R-448A/R-449A		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/25°F SST	6°C TD/-4°F SST	10°F TD/25°F SST	6°C TD/-4°F SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6H^A	LSH035 LSH040	4,000	1,200	4,500	1,300	1	685	1,164
6	CEL0045*±6H^A	LSH040 LSH047	5,400	1,550	6,100	1,750	1	641	1,088
6	CEL0065*±6H^A	LSH065	7,450	2,150	8,300	2,400	2	1,371	2,329
6	CEL0080*±6H^A	LSH075	8,650	2,500	9,650	2,800	2	1,371	2,329
6	CEL0100*±6H^A	LSH090	10,350	3,000	11,400	3,300	2	1,281	2,176
6	CEL0130*±6H^A	LSH120	13,800	4,000	15,500	4,500	3	2,056	3,493
6	CEL0155*±6H^A	LSH140	16,100	4,650	18,400	5,300	3	1,922	3,265
6	CEL0170*±6H^A	LSH160	18,400	5,300	20,600	5,950	4	2,741	4,658
6	CEL0205*±6H^A	LSH180	20,700	6,000	23,100	6,650	4	2,562	4,353
6	CEL0240*±6H^A	LSH200	23,000	6,650	25,750	7,450	5	3,203	5,441
6	CEL0255*±6H^A	LSH240	27,600	7,950	30,950	8,950	6	4,112	6,986
6	CEL0310*±6H^A	LSH280	32,200	9,300	36,100	10,400	6	3,843	6,529
4	CEL0045*±4H^A	LSH041	4,700	1,400	5,200	1,500	1	667	1,132
4	CEL0070*±4H^A	LSH068	7,800	2,250	8,500	2,450	2	1,425	2,422
4	CEL0090*±4H^A	LSH080	9,200	2,650	10,100	2,900	2	1,332	2,263
4	CEL0135*±4H^A	LSH102	11,750	3,400	13,050	3,800	3	1,998	3,395
4	CEL0180*±4H^A	LSH136	15,650	4,500	17,650	5,100	4	2,664	4,527
4	CEL0220*±4H^A	LSH170	19,550	5,650	21,850	6,300	5	3,331	5,659
4	CEL0275*±4H^A	LSH204 LSH235	27,000	7,800	29,800	8,600	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

± = Y/S (see Nomenclature details)

A1 PERFORMANCE DATA

Application Capacity: Medium Temperature Hot Gas Defrost- 60 Hz

Please consult AWEF table on page 63 to confirm model meets DOE minimum AWEF

Please refer to Table 1: Capacity Correction Factors (page 6) if using Saturated Suction Temperatures different than listed in the information below

FPI	New Model	Legacy Model	R-407A/R-407F		R-407C		Fan Data		
			Application Capacity ¹		Application Capacity ¹				
			10°F TD/25°F SST	6°C TD/-4°F SST	10°F TD/25°F SST	6°C TD/-4°F SST	No. of Fans	CFM	m ³ H
			BTUH	Watts	BTUH	Watts			
6	CEL0040*±6H^A	LSH035 LSH040	4,500	1,300	-	-	1	685	1,164
6	CEL0045*±6H^A	LSH040 LSH047	6,100	1,750	-	-	1	641	1,088
6	CEL0065*±6H^A	LSH065	8,300	2,400	-	-	2	1,371	2,329
6	CEL0080*±6H^A	LSH075	9,650	2,800	-	-	2	1,371	2,329
6	CEL0100*±6H^A	LSH090	11,400	3,300	-	-	2	1,281	2,176
6	CEL0130*±6H^A	LSH120	15,500	4,500	-	-	3	2,056	3,493
6	CEL0155*±6H^A	LSH140	18,400	5,300	-	-	3	1,922	3,265
6	CEL0170*±6H^A	LSH160	20,600	5,950	-	-	4	2,741	4,658
6	CEL0205*±6H^A	LSH180	23,100	6,650	-	-	4	2,562	4,353
6	CEL0240*±6H^A	LSH200	25,750	7,450	-	-	5	3,203	5,441
6	CEL0255*±6H^A	LSH240	30,950	8,950	-	-	6	4,112	6,986
6	CEL0310*±6H^A	LSH280	36,100	10,400	-	-	6	3,843	6,529
4	CEL0045*±4H^A	LSH041	5,200	1,500	-	-	1	667	1,132
4	CEL0070*±4H^A	LSH068	8,500	2,450	-	-	2	1,425	2,422
4	CEL0090*±4H^A	LSH080	10,100	2,900	-	-	2	1,332	2,263
4	CEL0135*±4H^A	LSH102	13,050	3,800	-	-	3	1,998	3,395
4	CEL0180*±4H^A	LSH136	17,650	5,100	-	-	4	2,664	4,527
4	CEL0220*±4H^A	LSH170	21,850	6,300	-	-	5	3,331	5,659
4	CEL0275*±4H^A	LSH204 LSH235	29,800	8,600	-	-	6	3,997	6,790

Notes:

¹ = Capacities shown are Application Capacities reflecting nominal operation at 10°F TD. For models within the scope of the DOE AWEF (Annual Walk-in Energy Factor) standard, the Net Capacity is determined by the AHRI 1250 test method. DOE will publish this compliance data at www.regulations.doe.gov

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

Net Capacity is available upon request

± = Y/S (see Nomenclature details)

SPECIFICATIONS

Hot Gas Defrost- 60 Hz

FPI	New Model	HP	2-Speed EC Motor (Totally Enclosed)				Drain Pan Heaters			
			115/1/60				Watts	115/1/60	230/1/60	460/1/60
			Amps	Watts	MCA	MOPD		Total Amps		
6	CEL0040*±6HMA	1/20	0.9	55	1.1	20	150	1.3	0.7	0.3
6	CEL0045*±6HMA	1/20	0.9	55	1.1	20	150	1.3	0.7	0.3
6	CEL0065*±6HMA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
6	CEL0080*±6HMA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
6	CEL0100*±6HMA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
6	CEL0130*±6HMA	1/20	2.7	165	2.9	20	450	3.9	2.0	1.0
6	CEL0155*±6HMA	1/20	2.7	165	2.9	20	450	3.9	2.0	1.0
6	CEL0170*±6HMA	1/20	3.6	220	3.8	20	600	5.2	2.6	1.3
6	CEL0205*±6HMA	1/20	3.6	220	3.8	20	600	5.2	2.6	1.3
6	CEL0240*±6HMA	1/20	4.5	275	4.7	20	750	6.5	3.3	1.6
6	CEL0255*±6HMA	1/20	5.4	330	5.6	20	900	7.8	3.9	2.0
6	CEL0310*±6HMA	1/20	5.4	330	5.6	20	900	7.8	3.9	2.0
4	CEL0045*±4HMA	1/20	0.9	55	1.1	20	150	1.3	0.7	0.3
4	CEL0070*±4HMA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
4	CEL0090*±4HMA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
4	CEL0135*±4HMA	1/20	2.7	165	2.9	20	450	3.9	2.0	1.0
4	CEL0180*±4HMA	1/20	3.6	220	3.8	20	600	5.2	2.6	1.3
4	CEL0220*±4HMA	1/20	4.5	275	4.7	20	750	6.5	3.3	1.6
4	CEL0275*±4HMA	1/20	5.4	330	5.6	20	900	7.8	3.9	2.0

FPI	New Model	HP	2-Speed EC Motor (Totally Enclosed)				Drain Pan Heaters			
			208-230/1/60				Watts	115/1/60	230/1/60	460/1/60
			Amps	Watts	MCA	MOPD		Total Amps		
6	CEL0040*±6HMA	1/20	0.5	55	0.6	15	150	1.3	0.7	0.3
6	CEL0045*±6HMA	1/20	0.5	55	0.6	15	150	1.3	0.7	0.3
6	CEL0065*±6HMA	1/20	1.0	110	1.1	15	300	2.6	1.3	0.7
6	CEL0080*±6HMA	1/20	1.0	110	1.1	15	300	2.6	1.3	0.7
6	CEL0100*±6HMA	1/20	1.0	110	1.1	15	300	2.6	1.3	0.7
6	CEL0130*±6HMA	1/20	1.4	165	1.6	15	450	3.9	2.0	1.0
6	CEL0155*±6HMA	1/20	1.4	165	1.6	15	450	3.9	2.0	1.0
6	CEL0170*±6HMA	1/20	1.9	220	2.1	15	600	5.2	2.6	1.3
6	CEL0205*±6HMA	1/20	1.9	220	2.1	15	600	5.2	2.6	1.3
6	CEL0240*±6HMA	1/20	2.4	275	2.6	15	750	6.5	3.3	1.6
6	CEL0255*±6HMA	1/20	2.9	330	3.1	15	900	7.8	3.9	2.0
6	CEL0310*±6HMA	1/20	2.9	330	3.1	15	900	7.8	3.9	2.0
4	CEL0045*±4HMA	1/20	0.5	55	0.6	15	150	1.3	0.7	0.3
4	CEL0070*±4HMA	1/20	1.0	110	1.1	15	300	2.6	1.3	0.7
4	CEL0090*±4HMA	1/20	1.0	110	1.1	15	300	2.6	1.3	0.7
4	CEL0135*±4HMA	1/20	1.4	165	1.6	15	450	3.9	2.0	1.0
4	CEL0180*±4HMA	1/20	1.9	220	2.1	15	600	5.2	2.6	1.3
4	CEL0220*±4HMA	1/20	2.4	275	2.6	15	750	6.5	3.3	1.6
4	CEL0275*±4HMA	1/20	2.9	330	3.1	15	900	7.8	3.9	2.0

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Hot Gas Defrost- 60 Hz

FPI	New Model	HP	1-Speed EC Motor (Totally Enclosed)				Watts	Drain Pan Heaters		
			115/1/60					115/1/60	230/1/60	460/1/60
			Amp	Watt	MCA	MOPD				
6	CEL0040*±6HEA	1/20	0.9	55	1.1	20	150	1.3	0.7	0.3
6	CEL0045*±6HEA	1/20	0.9	55	1.1	20	150	1.3	0.7	0.3
6	CEL0065*±6HEA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
6	CEL0080*±6HEA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
6	CEL0100*±6HEA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
6	CEL0130*±6HEA	1/20	2.7	165	2.9	20	450	3.9	2.0	1.0
6	CEL0155*±6HEA	1/20	2.7	165	2.9	20	450	3.9	2.0	1.0
6	CEL0170*±6HEA	1/20	3.6	220	3.8	20	600	5.2	2.6	1.3
6	CEL0205*±6HEA	1/20	3.6	220	3.8	20	600	5.2	2.6	1.3
6	CEL0240*±6HEA	1/20	4.5	270	4.7	20	750	6.5	3.3	1.6
6	CEL0255*±6HEA	1/20	5.4	330	5.6	20	900	7.8	3.9	2.0
6	CEL0310*±6HEA	1/20	5.4	330	5.6	20	900	7.8	3.9	2.0
4	CEL0045*±4HEA	1/20	0.9	55	1.1	20	150	1.3	0.7	0.3
4	CEL0070*±4HEA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
4	CEL0090*±4HEA	1/20	1.8	110	2.0	20	300	2.6	1.3	0.7
4	CEL0135*±4HEA	1/20	2.7	165	2.9	20	450	3.9	2.0	1.0
4	CEL0180*±4HEA	1/20	3.6	220	3.8	20	600	5.2	2.6	1.3
4	CEL0220*±4HEA	1/20	4.5	275	4.7	20	750	6.5	3.3	1.6
4	CEL0275*±4HEA	1/20	5.4	330	5.6	20	900	7.8	3.9	2.0

FPI	New Model	HP	1-Speed EC Motor (Totally Enclosed)				Watts	Drain Pan Heaters		
			208-230/1/60					115/1/60	230/1/60	460/1/60
			Amps	Watts	MCA	MOPD				
6	CEL0040*±6HEA	1/20	0.5	59	0.6	15	150	1.3	0.7	0.3
6	CEL0045*±6HEA	1/20	0.5	59	0.6	15	150	1.3	0.7	0.3
6	CEL0065*±6HEA	1/20	1.0	118	1.1	15	300	2.6	1.3	0.7
6	CEL0080*±6HEA	1/20	1.0	118	1.1	15	300	2.6	1.3	0.7
6	CEL0100*±6HEA	1/20	1.0	118	1.1	15	300	2.6	1.3	0.7
6	CEL0130*±6HEA	1/20	1.5	177	1.6	15	450	3.9	2.0	1.0
6	CEL0155*±6HEA	1/20	1.5	177	1.6	15	450	3.9	2.0	1.0
6	CEL0170*±6HEA	1/20	2.0	236	2.1	15	600	5.2	2.6	1.3
6	CEL0205*±6HEA	1/20	2.0	236	2.1	15	600	5.2	2.6	1.3
6	CEL0240*±6HEA	1/20	2.5	295	2.6	15	750	6.5	3.3	1.6
6	CEL0255*±6HEA	1/20	3.0	354	3.1	15	900	7.8	3.9	2.0
6	CEL0310*±6HEA	1/20	3.0	354	3.1	15	900	7.8	3.9	2.0
4	CEL0045*±4HEA	1/20	0.5	59	0.6	15	150	1.3	0.7	0.3
4	CEL0070*±4HEA	1/20	1.0	118	1.1	15	300	2.6	1.3	0.7
4	CEL0090*±4HEA	1/20	1.0	118	1.1	15	300	2.6	1.3	0.7
4	CEL0135*±4HEA	1/20	1.5	177	1.6	15	450	3.9	2.0	1.0
4	CEL0180*±4HEA	1/20	2.0	236	2.1	15	600	5.2	2.6	1.3
4	CEL0220*±4HEA	1/20	2.5	295	2.6	15	750	6.5	3.3	1.6
4	CEL0275*±4HEA	1/20	3.0	354	3.1	15	900	7.8	3.9	2.0

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Hot Gas Defrost- 60 Hz

FPI	New Model	HP	PSC Motor (Totally Enclosed)				Watts	Drain Pan Heaters		
			115/1/60					115/1/60	230/1/60	460/1/60
			Amps	Watts	MCA	MOPD				
6	CEL0040*±6HCA	1/20	1.0	82	1.3	20	150	1.3	0.7	0.3
6	CEL0045*±6HCA	1/20	1.0	82	1.3	20	150	1.3	0.7	0.3
6	CEL0065*±6HCA	1/20	2.0	164	2.3	20	300	2.6	1.3	0.7
6	CEL0080*±6HCA	1/20	2.0	164	2.3	20	300	2.6	1.3	0.7
6	CEL0100*±6HCA	1/20	2.0	164	2.3	20	300	2.6	1.3	0.7
6	CEL0130*±6HCA	1/20	3.0	246	3.3	20	450	3.9	2.0	1.0
6	CEL0155*±6HCA	1/20	3.0	246	3.3	20	450	3.9	2.0	1.0
6	CEL0170*±6HCA	1/20	4.0	328	4.3	20	600	5.2	2.6	1.3
6	CEL0205*±6HCA	1/20	4.0	328	4.3	20	600	5.2	2.6	1.3
6	CEL0240*±6HCA	1/20	5.0	410	5.3	20	750	6.5	3.3	1.6
6	CEL0255*±6HCA	1/20	6.0	492	6.3	20	900	7.8	3.9	2.0
6	CEL0310*±6HCA	1/20	6.0	492	6.3	20	900	7.8	3.9	2.0
4	CEL0045*±4HCA	1/20	1.0	82	1.3	20	150	1.3	0.7	0.3
4	CEL0070*±4HCA	1/20	2.0	164	2.3	20	300	2.6	1.3	0.7
4	CEL0090*±4HCA	1/20	2.0	164	2.3	20	300	2.6	1.3	0.7
4	CEL0135*±4HCA	1/20	3.0	246	3.3	20	450	3.9	2.0	1.0
4	CEL0180*±4HCA	1/20	4.0	328	4.3	20	600	5.2	2.6	1.3
4	CEL0220*±4HCA	1/20	5.0	410	5.3	20	750	6.5	3.3	1.6
4	CEL0275*±4HCA	1/20	6.0	492	6.3	20	900	7.8	3.9	2.0

FPI	New Model	HP	PSC Motor (Totally Enclosed)				Watts	Drain Pan Heaters		
			208-230/1/60					115/1/60	230/1/60	460/1/60
			Amps	Watts	MCA	MOPD				
6	CEL0040*±6HCA	1/20	0.5	91	0.6	15	150	1.3	0.7	0.3
6	CEL0045*±6HCA	1/20	0.5	91	0.6	15	150	1.3	0.7	0.3
6	CEL0065*±6HCA	1/20	1.0	182	1.1	15	300	2.6	1.3	0.7
6	CEL0080*±6HCA	1/20	1.0	182	1.1	15	300	2.6	1.3	0.7
6	CEL0100*±6HCA	1/20	1.0	182	1.1	15	300	2.6	1.3	0.7
6	CEL0130*±6HCA	1/20	1.5	273	1.6	15	450	3.9	2.0	1.0
6	CEL0155*±6HCA	1/20	1.5	273	1.6	15	450	3.9	2.0	1.0
6	CEL0170*±6HCA	1/20	2.0	364	2.1	15	600	5.2	2.6	1.3
6	CEL0205*±6HCA	1/20	2.0	364	2.1	15	600	5.2	2.6	1.3
6	CEL0240*±6HCA	1/20	2.5	455	2.6	15	750	6.5	3.3	1.6
6	CEL0255*±6HCA	1/20	3.0	546	3.1	15	900	7.8	3.9	2.0
6	CEL0310*±6HCA	1/20	3.0	546	3.1	15	900	7.8	3.9	2.0
4	CEL0045*±4HCA	1/20	0.5	91	0.6	15	150	1.3	0.7	0.3
4	CEL0070*±4HCA	1/20	1.0	182	1.1	15	300	2.6	1.3	0.7
4	CEL0090*±4HCA	1/20	1.0	182	1.1	15	300	2.6	1.3	0.7
4	CEL0135*±4HCA	1/20	1.5	273	1.6	15	450	3.9	2.0	1.0
4	CEL0180*±4HCA	1/20	2.0	364	2.1	15	600	5.2	2.6	1.3
4	CEL0220*±4HCA	1/20	2.5	455	2.6	15	750	6.5	3.3	1.6
4	CEL0275*±4HCA	1/20	3.0	546	3.1	15	900	7.8	3.9	2.0

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Hot Gas Defrost- 60 Hz

FPI	New Model	HP	PSC Motor (Totally Enclosed)				Drain Pan Heaters			
			460/1/60				Watts	115/1/60	230/1/60	460/1/60
			Amps	Watts	MCA	MOPD		Total Amps		
6	CEL0040*±6HCA	1/20	0.4	117	0.5	15	150	1.3	0.7	0.3
6	CEL0045*±6HCA	1/20	0.4	117	0.5	15	150	1.3	0.7	0.3
6	CEL0065*±6HCA	1/20	0.8	234	0.9	15	300	2.6	1.3	0.7
6	CEL0080*±6HCA	1/20	0.8	234	0.9	15	300	2.6	1.3	0.7
6	CEL0100*±6HCA	1/20	0.8	234	0.9	15	300	2.6	1.3	0.7
6	CEL0130*±6HCA	1/20	1.2	351	1.3	15	450	3.9	2.0	1.0
6	CEL0155*±6HCA	1/20	1.2	351	1.3	15	450	3.9	2.0	1.0
6	CEL0170*±6HCA	1/20	1.6	468	1.7	15	600	5.2	2.6	1.3
6	CEL0205*±6HCA	1/20	1.6	468	1.7	15	600	5.2	2.6	1.3
6	CEL0240*±6HCA	1/20	2.0	585	2.1	15	750	6.5	3.3	1.6
6	CEL0255*±6HCA	1/20	2.4	702	2.5	15	900	7.8	3.9	2.0
6	CEL0310*±6HCA	1/20	2.4	702	2.5	15	900	7.8	3.9	2.0
4	CEL0045*±4HCA	1/20	0.4	117	0.5	15	150	1.3	0.7	0.3
4	CEL0070*±4HCA	1/20	0.8	234	0.9	15	300	2.6	1.3	0.7
4	CEL0090*±4HCA	1/20	0.8	234	0.9	15	300	2.6	1.3	0.7
4	CEL0135*±4HCA	1/20	1.2	351	1.3	15	450	3.9	2.0	1.0
4	CEL0180*±4HCA	1/20	1.6	468	1.7	15	600	5.2	2.6	1.3
4	CEL0220*±4HCA	1/20	2.0	585	2.1	15	750	6.5	3.3	1.6
4	CEL0275*±4HCA	1/20	2.4	702	2.5	15	900	7.8	3.9	2.0

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Hot Gas Defrost- 50 Hz

FPI	New Model	HP	2-Speed EC Motor (Totally Enclosed)				Drain Pan Heaters	
			220/1/50				Watts	220/1/50
			Amps	Watts	MCA	MOPD		
6	CEL0040*±6HMA	1/20	0.5	55	0.6	15	135	0.6
6	CEL0045*±6HMA	1/20	0.5	55	0.6	15	135	0.6
6	CEL0065*±6HMA	1/20	1.0	110	1.1	15	275	1.2
6	CEL0080*±6HMA	1/20	1.0	110	1.1	15	275	1.2
6	CEL0100*±6HMA	1/20	1.0	110	1.1	15	275	1.2
6	CEL0130*±6HMA	1/20	1.5	165	1.6	15	410	1.9
6	CEL0155*±6HMA	1/20	1.5	165	1.6	15	410	1.9
6	CEL0170*±6HMA	1/20	2.0	220	2.1	15	550	2.5
6	CEL0205*±6HMA	1/20	2.0	220	2.1	15	550	2.5
6	CEL0240*±6HMA	1/20	2.5	275	2.6	15	690	3.1
6	CEL0255*±6HMA	1/20	3.0	330	3.1	15	825	3.7
6	CEL0310*±6HMA	1/20	3.0	330	3.1	15	825	3.7
4	CEL0045*±4HMA	1/20	0.5	55	0.6	15	135	0.6
4	CEL0070*±4HMA	1/20	1.0	110	1.1	15	275	1.2
4	CEL0090*±4HMA	1/20	1.0	110	1.1	15	275	1.2
4	CEL0135*±4HMA	1/20	1.5	165	1.6	15	410	1.9
4	CEL0180*±4HMA	1/20	2.0	220	2.1	15	550	2.5
4	CEL0220*±4HMA	1/20	2.5	275	2.6	15	690	3.1
4	CEL0275*±4HMA	1/20	3.0	330	3.1	15	825	3.7

FPI	New Model	HP	1-Speed EC Motor (Totally Enclosed)				Drain Pan Heaters	
			220/1/50				Watts	220/1/50
			Amps	Watts	MCA	MOPD		
6	CEL0040*±6HEA	1/20	0.5	59	0.6	15	135	0.6
6	CEL0045*±6HEA	1/20	0.5	59	0.6	15	135	0.6
6	CEL0065*±6HEA	1/20	1.0	118	1.1	15	275	1.2
6	CEL0080*±6HEA	1/20	1.0	118	1.1	15	275	1.2
6	CEL0100*±6HEA	1/20	1.0	118	1.1	15	275	1.2
6	CEL0130*±6HEA	1/20	1.5	177	1.6	15	410	1.9
6	CEL0155*±6HEA	1/20	1.5	177	1.6	15	410	1.9
6	CEL0170*±6HEA	1/20	2.0	236	2.1	15	550	2.5
6	CEL0205*±6HEA	1/20	2.0	236	2.1	15	550	2.5
6	CEL0240*±6HEA	1/20	2.5	295	2.6	15	690	3.1
6	CEL0255*±6HEA	1/20	3.0	354	3.1	15	825	3.7
6	CEL0310*±6HEA	1/20	3.0	354	3.1	15	825	3.7
4	CEL0045*±4HEA	1/20	0.5	59	0.6	15	135	0.6
4	CEL0070*±4HEA	1/20	1.0	118	1.1	15	275	1.2
4	CEL0090*±4HEA	1/20	1.0	118	1.1	15	275	1.2
4	CEL0135*±4HEA	1/20	1.5	177	1.6	15	410	1.9
4	CEL0180*±4HEA	1/20	2.0	236	2.1	15	550	2.5
4	CEL0220*±4HEA	1/20	2.5	295	2.6	15	690	3.1
4	CEL0275*±4HEA	1/20	3.0	354	3.1	15	825	3.7

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

SPECIFICATIONS

Hot Gas Defrost- 50 Hz

FPI	New Model	HP	PSC Motor (Totally Enclosed)				Drain Pan Heaters	
			220/1/50				Watts	220/1/50
			Amps	Watts	MCA	MOPD		Total Amps
6	CEL0040*±6HCA	1/20	0.5	65	0.6	15	135	0.6
6	CEL0045*±6HCA	1/20	0.5	65	0.6	15	135	0.6
6	CEL0065*±6HCA	1/20	1.0	130	1.1	15	275	1.2
6	CEL0080*±6HCA	1/20	1.0	130	1.1	15	275	1.2
6	CEL0100*±6HCA	1/20	1.0	130	1.1	15	275	1.2
6	CEL0130*±6HCA	1/20	1.5	195	1.6	15	410	1.9
6	CEL0155*±6HCA	1/20	1.5	195	1.6	15	410	1.9
6	CEL0170*±6HCA	1/20	2.0	260	2.1	15	550	2.5
6	CEL0205*±6HCA	1/20	2.0	260	2.1	15	550	2.5
6	CEL0240*±6HCA	1/20	2.5	325	2.6	15	690	3.1
6	CEL0255*±6HCA	1/20	3.0	390	3.1	15	825	3.7
6	CEL0310*±6HCA	1/20	3.0	390	3.1	15	825	3.7
4	CEL0045*±4HCA	1/20	0.5	65	0.6	15	135	0.6
4	CEL0070*±4HCA	1/20	1.0	130	1.1	15	275	1.2
4	CEL0090*±4HCA	1/20	1.0	130	1.1	15	275	1.2
4	CEL0135*±4HCA	1/20	1.5	195	1.6	15	410	1.9
4	CEL0180*±4HCA	1/20	2.0	260	2.1	15	550	2.5
4	CEL0220*±4HCA	1/20	2.5	325	2.6	15	690	3.1
4	CEL0275*±4HCA	1/20	3.0	390	3.1	15	825	3.7

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

PHYSICAL DATA

Air Defrost

FPI	Model	No. of Fans	Coil Inlet OD	Suction OD	Equalizer OD	Drain MPT	Approx. Net Weight	
							lb	kg
6	CEL0045*±6A^A	1	1/2	1/2	1/4	3/4	33	15
6	CEL0055*±6A^A	1	1/2	5/8	1/4	3/4	36	16
6	CEL0060*±6A^A	1	1/2	5/8	1/4	3/4	36	16
6	CEL0095*±6A^A	2	1/2	5/8	1/4	3/4	51	23
6	CEL0105*±6A^A	2	1/2	5/8	1/4	3/4	52	24
6	CEL0115*±6A^A	2	1/2	7/8	1/4	3/4	56	26
6	CEL0125*±6A^A	2	1/2	7/8	1/4	3/4	56	26
6	CEL0155*±6A^A	3	1/2	7/8	1/4	3/4	67	30
6	CEL0190*±6A^A	3	1/2	7/8	1/4	3/4	73	33
6	CEL0250*±6A^A	4	1/2	7/8	1/4	3/4	94	43
6	CEL0295*±6A^A	5	1/2	7/8	1/4	3/4	115	52
6	CEL0350*±6A^A	6	1/2	1-1/8	1/4	3/4	133	60
6	CEL0380*±6A^A	6	1/2	1-1/8	1/4	3/4	137	62

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

± = Refrigerant Designator

PHYSICAL DATA

Air Defrost (CO₂ DX)

Model	No. of Fans	Coil Inlet ²	Suction OD ²	Drain MPT	Approx. Net Weight	
					lb	kg
CEL0045*C6A^A	1	3/8	3/8	3/4	33	15
CEL0055*C6A^A	1	3/8	3/8	3/4	36	16
CEL0060*C6A^A	1	3/8	3/8	3/4	36	16
CEL0095*C6A^A	2	3/8	3/8	3/4	51	23
CEL0105*C6A^A	2	3/8	3/8	3/4	52	24
CEL0115*C6A^A	2	3/8	3/8	3/4	56	26
CEL0125*C6A^A	2	3/8	3/8	3/4	56	26
CEL0155*C6A^A	3	3/8	3/8	3/4	67	30
CEL0190*C6A^A	3	3/8	3/8	3/4	73	33
CEL0250*C6A^A	4	3/8	1/2	3/4	94	43
CEL0295*C6A^A	5	3/8	1/2	3/4	115	52
CEL0350*C6A^A	6	3/8	1/2	3/4	133	60
CEL0380*C6A^A	6	1/2	5/8	3/4	137	62

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

² = Connection sizes may vary, if TD is lesser or greater than 10°F

PHYSICAL DATA

Electric Defrost

FPI	Model	No. of Fans	Coil Inlet OD	Suction OD	Equalizer OD	Drain MPT	Approx. Net Weight	
							lb	kg
6	CEL0040*±6E^A	1	1/2	5/8	1/4	3/4	36	16
6	CEL0045*±6E^A	1	1/2	5/8	1/4	3/4	38	17
6	CEL0065*±6E^A	2	1/2	5/8	1/4	3/4	54	24
6	CEL0080*±6E^A	2	1/2	5/8	1/4	3/4	54	24
6	CEL0100*±6E^A	2	1/2	7/8	1/4	3/4	59	27
6	CEL0130*±6E^A	3	1/2	7/8	1/4	3/4	71	32
6	CEL0155*±6E^A	3	1/2	1-1/8	1/4	3/4	78	35
6	CEL0170*±6E^A	4	1/2	7/8	1/4	3/4	91	41
6	CEL0205*±6E^A	4	1/2	1-1/8	1/4	3/4	100	45
6	CEL0240*±6E^A	5	1/2	1-1/8	1/4	3/4	120	54
6	CEL0255*±6E^A	6	1/2	1-1/8	1/4	3/4	134	61
6	CEL0310*±6E^A	6	1/2	1-1/8	1/4	3/4	146	66
4	CEL0045*±4E^A	1	1/2	5/8	1/4	3/4	38	17
4	CEL0070*±4E^A	2	1/2	5/8	1/4	3/4	53	24
4	CEL0090*±4E^A	2	1/2	7/8	1/4	3/4	59	27
4	CEL0135*±4E^A	3	1/2	7/8	1/4	3/4	77	35
4	CEL0180*±4E^A	4	1/2	1-1/8	1/4	3/4	100	45
4	CEL0220*±4E^A	5	1/2	1-1/8	1/4	3/4	119	54
4	CEL0275*±4E^A	6	1/2	1-1/8	1/4	3/4	142	64

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

± = Refrigerant Designator

PHYSICAL DATA

Electric Defrost (CO₂ DX)

FPI	Model	No. of Fans	Coil Inlet ²	Suction OD ²	Drain MPT	Approx. Net Weight	
						lb	kg
6	CELO040*C6E^A	1	3/8	3/8	3/4	36	16
6	CELO045*C6E^A	1	3/8	3/8	3/4	38	17
6	CELO065*C6E^A	2	3/8	3/8	3/4	54	24
6	CELO080*C6E^A	2	3/8	1/2	3/4	54	24
6	CELO100*C6E^A	2	3/8	1/2	3/4	59	27
6	CELO130*C6E^A	3	3/8	1/2	3/4	71	32
6	CELO155*C6E^A	3	3/8	1/2	3/4	78	35
6	CELO170*C6E^A	4	3/8	1/2	3/4	91	41
6	CELO205*C6E^A	4	3/8	1/2	3/4	100	45
6	CELO240*C6E^A	5	3/8	5/8	3/4	120	54
6	CELO255*C6E^A	6	3/8	5/8	3/4	134	61
6	CELO310*C6E^A	6	3/8	5/8	3/4	146	66
4	CELO045*C4E^A	1	3/8	3/8	3/4	38	17
4	CELO070*C4E^A	2	3/8	3/8	3/4	53	24
4	CELO090*C4E^A	2	3/8	1/2	3/4	59	27
4	CELO135*C4E^A	3	3/8	1/2	3/4	77	35
4	CELO180*C4E^A	4	3/8	1/2	3/4	100	45
4	CELO220*C4E^A	5	3/8	1/2	3/4	119	54
4	CELO275*C4E^A	6	3/8	5/8	3/4	142	64

Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

² = Connection sizes may vary, if TD is lesser or greater than 10°F

PHYSICAL DATA

Hot Gas Defrost

FPI	Model	No. of Fans	Coil Inlet OD	Suction OD	Equalizer OD	Drain MPT	Side Port OD	Hot Gas Pan Connection OD	Approx. Net Weight	
									lb	kg
6	CELO040*±6H^A	1	1/2	5/8	1/4	3/4	1/2	5/8	38	17
6	CELO045*±6H^A	1	1/2	5/8	1/4	3/4	1/2	5/8	40	18
6	CELO065*±6H^A	2	1/2	5/8	1/4	3/4	1/2	5/8	56	25
6	CELO080*±6H^A	2	1/2	5/8	1/4	3/4	1/2	5/8	56	25
6	CELO100*±6H^A	2	1/2	7/8	1/4	3/4	1/2	5/8	61	27
6	CELO130*±6H^A	3	1/2	7/8	1/4	3/4	1/2	5/8	73	33
6	CELO155*±6H^A	3	1/2	1-1/8	1/4	3/4	1/2	5/8	80	36
6	CELO170*±6H^A	4	1/2	7/8	1/4	3/4	1/2	5/8	93	42
6	CELO205*±6H^A	4	1/2	1-1/8	1/4	3/4	1/2	5/8	102	46
6	CELO240*±6H^A	5	1/2	1-1/8	1/4	3/4	1/2	5/8	122	55
6	CELO255*±6H^A	6	1/2	1-1/8	1/4	3/4	1/2	5/8	136	62
6	CELO310*±6H^A	6	1/2	1-1/8	1/4	3/4	1/2	5/8	148	67
4	CELO045*±4H^A	1	1/2	5/8	1/4	3/4	1/2	5/8	40	18
4	CELO070*±4H^A	2	1/2	5/8	1/4	3/4	1/2	5/8	55	25
4	CELO090*±4H^A	2	1/2	7/8	1/4	3/4	1/2	5/8	61	28
4	CELO135*±4H^A	3	1/2	7/8	1/4	3/4	1/2	5/8	79	36
4	CELO180*±4H^A	4	1/2	1-1/8	1/4	3/4	1/2	5/8	102	46
4	CELO220*±4H^A	5	1/2	1-1/8	1/4	3/4	1/2	5/8	121	55
4	CELO275*±4H^A	6	1/2	1-1/8	1/4	3/4	1/2	5/8	144	65


Notes:

* = Electrical Code Designator (see Nomenclature details)

^ = Motor Code Designator (see Nomenclature details)

± = Refrigerant Designator

DIMENSIONAL DRAWINGS

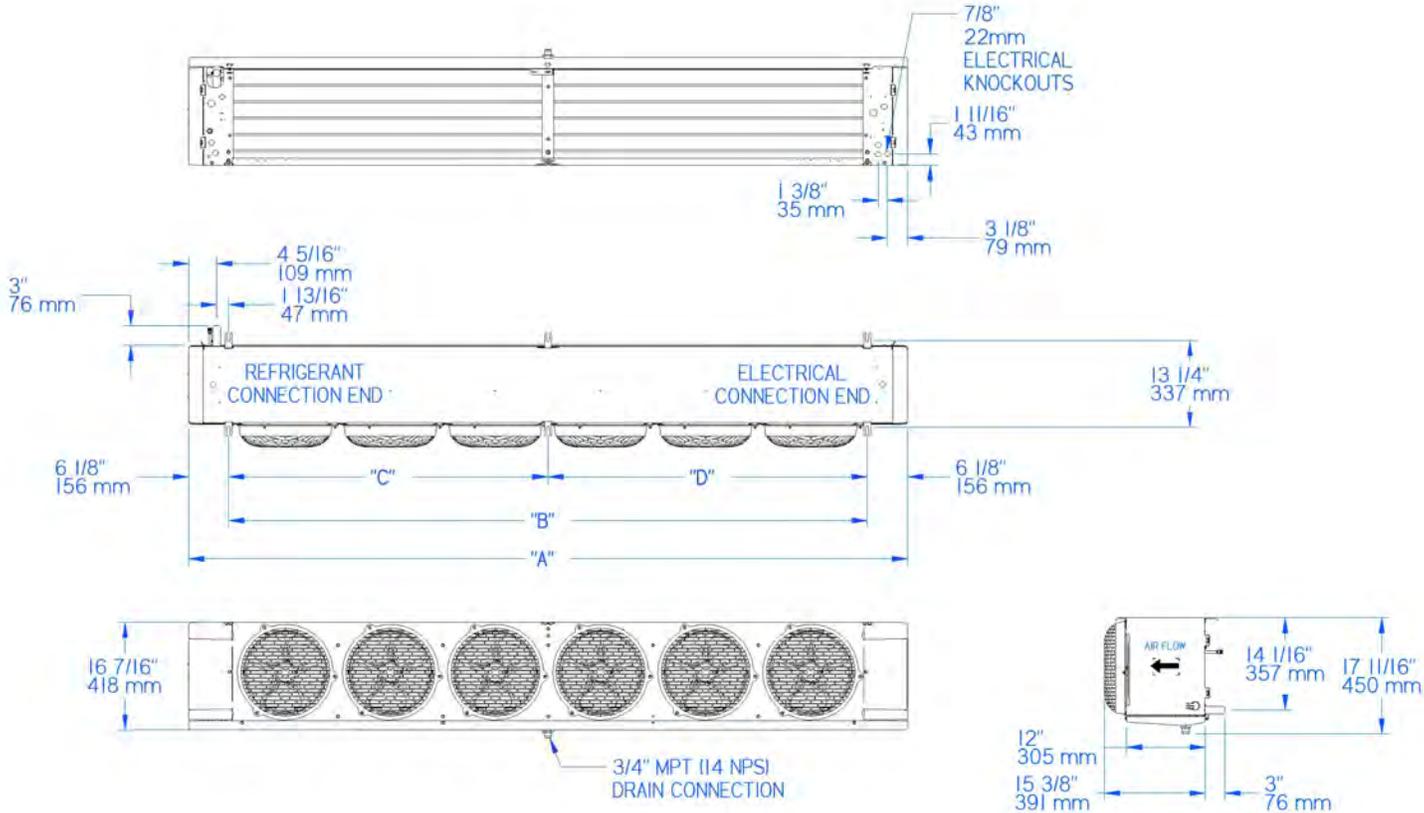

No. of Fans	A		B		C		D	
	in.	mm	in.	mm	in.	mm	in.	mm
1	29.5	749	17.25	438	-	-	-	-
2	45.5	1,156	33.25	845	-	-	-	-
3	61.5	1,562	49.25	1,251	-	-	-	-
4	77.5	1,969	65.25	1,657	-	-	-	-
5	93.5	2,375	81.25	2,064	48.63	1,235	32.63	829
6	109.5	2,781	97.25	2,470	48.63	1,235	48.63	1,235

Note:
Hanger brackets will accept 3/8" / 9.5 mm hanger rods

DOE Rated AWEF

AWEF DATA

Air Defrost/2-Speed EC Motors

FPI	Model	Cooler							CO ₂ DX
		R-404A/ R-507A	R-448A/ R0449A	R-407A/ R-407F	R-407C	R454A	R454C	R455A	
		AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	
6	CELO045*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO055*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO060*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO095*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO105*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO115*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO125*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO155*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO190*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO250*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO295*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO350*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00
6	CELO380*±6AMA	9.00	9.00	9.00	9.00	9.00	9.00	9.00	9.00

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator

DOE Rated AWEF

AWEF DATA

Electric Defrost/1-Speed EC Motors

FPI	Model	Freezer							CO ₂ DX
		R-404A/ R-507A	R-448A/ R0449A	R-407A/ R-407F	R-407C	R454A	R454C	R455A	
		AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	
6	CEL0040*±6EEA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CEL0045*±6EEA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CEL0065*±6EEA	4.00	4.03	4.02	-	4.00	4.03	4.02	4.00
6	CEL0080*±6EEA	4.03	4.03	4.03	-	4.03	4.03	4.03	4.03
6	CEL0100*±6EEA	4.00	4.06	4.06	-	4.00	4.06	4.06	4.00
6	CEL0130*±6EEA	4.09	4.09	4.09	-	4.09	4.09	4.09	4.09
6	CEL0155*±6EEA	4.10	4.10	4.10	-	4.10	4.10	4.10	4.10
6	CEL0170*±6EEA	4.14	4.14	4.14	-	4.14	4.14	4.14	4.14
6	CEL0205*±6EEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CEL0240*±6EEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CEL0255*±6EEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CEL0310*±6EEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CEL0045*±4EEA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
4	CEL0070*±4EEA	3.99	3.99	3.99	-	3.99	-	3.99	-
4	CEL0090*±4EEA	4.02	4.02	4.02	-	4.02	4.02	4.02	4.02
4	CEL0135*±4EEA	4.07	4.07	4.07	-	4.07	4.07	4.07	4.07
4	CEL0180*±4EEA	4.12	4.12	4.12	-	4.12	4.12	4.12	4.12
4	CEL0220*±4EEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CEL0275*±4EEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator

DOE Rated AWEF

AWEF DATA

Electric Defrost/2-Speed EC Motors

FPI	Model	Cooler							CO ₂ DX
		R-404A/ R-507A	R-448A/ R0449A	R-407A/ R-407F	R-407C	R454A	R454C	R455A	
		AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	
6	CEL0040*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0045*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0065*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0080*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0100*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0130*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0155*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0170*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0205*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0240*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0255*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0310*±6EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0045*±4EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0070*±4EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	-
4	CEL0090*±4EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0135*±4EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0180*±4EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0220*±4EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0275*±4EMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00

FPI	Model	Freezer							CO ₂ DX
		R-404A/ R-507A	R-448A/ R0449A	R-407A/ R-407F	R-407C	R454A	R454C	R455A	
		AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	
6	CEL0040*±6EMA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CEL0045*±6EMA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CEL0065*±6EMA	4.00	4.03	4.02	-	4.00	4.03	4.02	4.00
6	CEL0080*±6EMA	4.00	4.00	4.00	-	4.00	4.00	4.00	4.00
6	CEL0100*±6EMA	4.03	4.03	4.03	-	4.03	4.03	4.03	4.03
6	CEL0130*±6EMA	4.06	4.06	4.06	-	4.06	4.06	4.06	4.06
6	CEL0155*±6EMA	4.09	4.09	4.09	-	4.09	4.09	4.09	4.09
6	CEL0170*±6EMA	4.10	4.10	4.10	-	4.10	4.10	4.10	4.10
6	CEL0205*±6EMA	4.14	4.14	4.14	-	4.14	4.14	4.14	4.14
6	CEL0240*±6EMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CEL0255*±6EMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CEL0310*±6EMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CEL0045*±4EMA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
4	CEL0070*±4EMA	3.99	3.99	3.99	-	3.99	3.99	3.99	-
4	CEL0090*±4EMA	4.02	4.02	4.02	-	4.02	4.02	4.02	4.02
4	CEL0135*±4EMA	4.07	4.07	4.07	-	4.07	4.07	4.07	4.07
4	CEL0180*±4EMA	4.12	4.12	4.12	-	4.12	4.12	4.12	4.12
4	CEL0220*±4EMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CEL0275*±4EMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator

DOE Rated AWEF

AWEF DATA

Hot Gas Defrost/1-Speed EC Motors

FPI	Model	Freezer							CO ₂ DX
		R-404A/ R-507A	R-448A/ R0449A	R-407A/ R-407F	R-407C	R454A	R454C	R455A	
		AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	
6	CELO040*±6HEA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CELO045*±6HEA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CELO065*±6HEA	4.00	4.03	4.02	-	4.00	4.03	4.02	4.00
6	CELO080*±6HEA	4.03	4.03	4.03	-	4.03	4.03	4.03	4.00
6	CELO100*±6HEA	4.06	4.06	4.06	-	4.06	4.06	4.06	4.03
6	CELO130*±6HEA	4.09	4.09	4.09	-	4.09	4.09	4.09	4.06
6	CELO155*±6HEA	4.10	4.10	4.10	-	4.10	4.10	4.10	4.09
6	CELO170*±6HEA	4.14	4.14	4.14	-	4.14	4.14	4.14	4.10
6	CELO205*±6HEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.14
6	CELO240*±6HEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CELO255*±6HEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CELO310*±6HEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CELO045*±4HEA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
4	CELO070*±4HEA	3.99	3.99	3.99	-	3.99	-	3.99	-
4	CELO090*±4HEA	4.02	4.02	4.02	-	4.02	4.02	4.02	4.02
4	CELO135*±4HEA	4.07	4.07	4.07	-	4.07	4.07	4.07	4.07
4	CELO180*±4HEA	4.12	4.12	4.12	-	4.12	4.12	4.12	4.12
4	CELO220*±4HEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CELO275*±4HEA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

DOE Rated AWEF

AWEF DATA

Hot Gas Defrost/2-Speed EC Motors

FPI	Model	Cooler							CO ₂ DX
		R-404A/ R-507A	R-448A/ R0449A	R-407A/ R-407F	R-407C	R454A	R454C	R455A	
		AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	
6	CEL0040*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0045*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0065*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0080*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0100*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0130*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0155*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0170*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0205*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0240*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0255*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
6	CEL0310*±6HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0045*±4HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0070*±4HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	-
4	CEL0090*±4HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0135*±4HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0180*±4HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0220*±4HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00
4	CEL0275*±4HMA	9.00	9.00	9.00	-	9.00	9.00	9.00	9.00

FPI	Model	Freezer							CO ₂
		R-404A/ R-507A	R-448A/ R0449A	R-407A/ R-407F	R-407C	R454A	R454C	R455A	
		AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	AWEF	
6	CEL0040*±6HMA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CEL0045*±6HMA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
6	CEL0065*±6HMA	4.00	4.03	4.02	-	4.00	4.03	4.02	4.00
6	CEL0080*±6HMA	4.00	4.00	4.00	-	4.00	4.00	4.00	4.00
6	CEL0100*±6HMA	4.03	4.03	4.03	-	4.03	4.03	4.03	4.03
6	CEL0130*±6HMA	4.06	4.06	4.06	-	4.06	4.06	4.06	4.06
6	CEL0155*±6HMA	4.09	4.09	4.09	-	4.09	4.09	4.09	4.09
6	CEL0170*±6HMA	4.10	4.10	4.10	-	4.10	4.10	4.10	4.10
6	CEL0205*±6HMA	4.14	4.14	4.14	-	4.14	4.14	4.14	4.14
6	CEL0240*±6HMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CEL0255*±6HMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
6	CEL0310*±6HMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CEL0045*±4HMA	3.96	3.96	3.96	-	3.96	3.96	3.96	3.96
4	CEL0070*±4HMA	3.99	3.99	3.99	-	3.99	3.99	3.99	-
4	CEL0090*±4HMA	4.02	4.02	4.02	-	4.02	4.02	4.02	4.02
4	CEL0135*±4HMA	4.07	4.07	4.07	-	4.07	4.07	4.07	4.07
4	CEL0180*±4HMA	4.12	4.12	4.12	-	4.12	4.12	4.12	4.12
4	CEL0220*±4HMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15
4	CEL0275*±4HMA	4.15	4.15	4.15	-	4.15	4.15	4.15	4.15

Notes:

* = Electrical Code Designator (see Nomenclature details)

± = Refrigerant Designator (see Nomenclature details)

HOT GAS REVERSE CYCLE KITS

Shipped Loose Accessories

FPI	Model	TXV Bypass and Liquid Line Piping Kit (Reverse Cycle)	TXV Liquid Line Piping Kit (Three Pipe or Rev Cycle w/o TXV Bypass)	Suction/Drain Pan Check Valve Piping Kit (Reverse Cycle)	Drain Pan Check Valve Piping Kit (Three Pipe)
		For TXV's SBF/SQE/BBI/EG	For TXV's SBF/SQE/BBI/EG		
6	CEL0040*S6H^A	50756301	50756302	50692204	50692302
6	CEL0045*S6H^A	50756301	50756302	50692204	50692302
6	CEL0065*S6H^A	50756301	50756302	50692204	50692302
6	CEL0080*S6H^A	50756301	50756302	50692204	50692302
6	CEL0100*S6H^A	50756301	50756302	50692225	50692302
6	CEL0130*S6H^A	50756301	50756302	50692225	50692302
6	CEL0155*S6H^A	50756301	50756302	50692206	50692302
6	CEL0170*S6H^A	50756301	50756302	50692205	50692302
6	CEL0205*S6H^A	50756301	50756302	50692206	50692302
6	CEL0240*S6H^A	50756301	50756302	50692206	50692302
6	CEL0255*S6H^A	50756301	50756302	50692206	50692302
6	CEL0310*S6H^A	50756301	50756302	50692206	50692302
4	CEL0045*S4H^A	50756301	50756302	50692204	50692302
4	CEL0070*S4H^A	50756301	50756302	50692204	50692302
4	CEL0090*S4H^A	50756301	50756302	50692205	50692302
4	CEL0135*S4H^A	50756301	50756302	50692205	50692302
4	CEL0180*S4H^A	50756301	50756302	50692206	50692302
4	CEL0220*S4H^A	50756301	50756302	50692206	50692302
4	CEL0275*S4H^A	50756301	50756302	50692206	50692302

REVERSE CYCLE PIPING

Reverse cycle defrost unit cooler operation


Reverse cycle defrost is a common method used in systems that include at least four unit coolers connected to a compressor rack. No more than 25% of the connected unit coolers are typically defrosted at the same time.

During reverse cycle, valving at the compressor rack diverts hot gas through the suction line to the defrosting unit cooler. See piping view in Figure 1. The suction line check valve directs the hot gas through the pan loop; heating the drain pan and preventing condensate from freezing during defrost. The hot gas exits the loop at the pan loop outlet header, passes through the drain pan check valve and enters the evaporator coil through the coil suction header. The hot refrigerant gas then flows through the defrosting coil, heating the finned surface and melting frost. As heat is transferred to the coil fins, hot refrigerant gas condenses to a liquid state. The refrigerant then exits the coil at the distributor side port, passes around the expansion valve through the bypass check valve and flows into the liquid refrigerant line. The liquid refrigerant then feeds other evaporators on the cooling cycle, evaporates, and returns to the compressor through their suction lines.

In some systems, electric drain pan heaters are used instead of a hot gas pan loop. Hot gas piping is simplified with the suction and drain pan check valves being eliminated. Electric drain pan heaters are energized during the defrost period, by a defrost control on the unit cooler or by a compressor rack controller.

REVERSE CYCLE DEFROST PIPING KEY COMPONENTS (FIG. 1)

- A. Hot gas drain pan loop
- B. Drain pan check valve
- C. Expansion valve
- D. Suction header
- E. Distributor
- F. Suction check valve
- G. Expansion valve bypass check valve

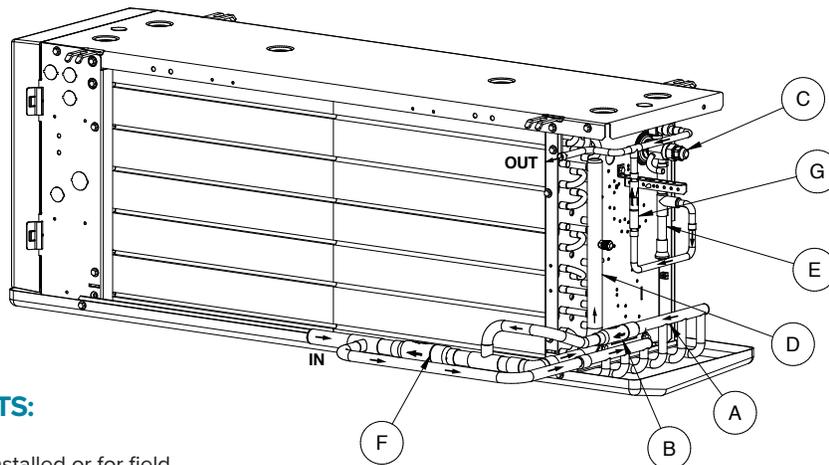

REVERSE CYCLE DEFROST PIPING KITS:

External check valve kit (available factory-installed or for field installation) includes suction check valve, drain pan check valve and piping to connect to suction header and hot gas drain pan loop. This kit is only necessary when the unit cooler is equipped with a hot gas drain pan loop.

Expansion valve bypass kit (available factory-installed or for field installation) includes expansion valve bypass check valve and piping to connect to the distributor side port and liquid line piping. The factory-installed version includes the expansion valve.

Use of external liquid/suction line heat exchanger with a reverse cycle system:

To increase the efficiency, higher performance and greater system protection, a heat exchanger may be beneficial to the system. In order to use a heat exchanger, the expansion valve bypass piping must be modified. See the piping view in Figure 2. The modification includes rerouting the pipe from the expansion valve bypass check valve to the inlet connection of the liquid line to the heat exchanger. A pipe needs to be routed from the liquid line outlet connection of the heat exchanger to the inlet connection of the thermostatic expansion valve.

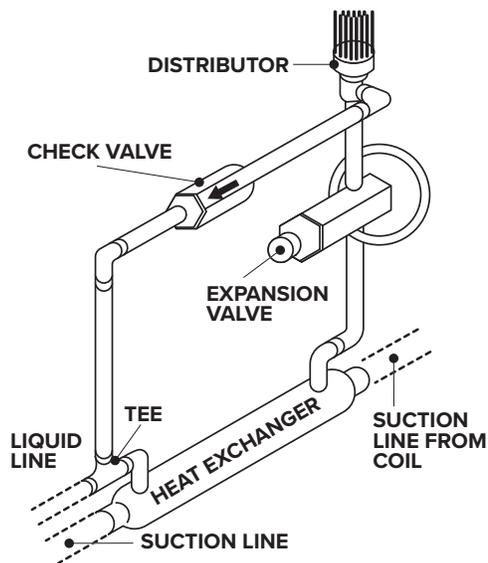


FIGURE 2. Typical Liquid Line Bypass Kit
(Shown assembled and modified for heat exchanger)

Three-pipe defrost unit cooler operation

Three-pipe defrost systems are connected to either a condensing unit or a compressor rack. No more than 33% of the connected unit coolers are typically defrosted at the same time.

During defrost, hot gas is directed through dedicated refrigerant piping (third pipe) to the defrosting unit cooler. See piping view in Figure 3. The hot gas enters the drain pan loop; heating the drain pan and preventing condensate from freezing during defrost. The hot gas exits the loop at the pan loop outlet header, passes through the drain pan check valve and enters the evaporator coil through the distributor side port connection. The hot refrigerant gas then flows through the defrosting coil, heating the finned surface and melting frost. As heat is transferred to the coil fins, hot refrigerant gas condenses to a liquid state. The refrigerant then exits the coil at the suction header.


Three-pipe defrost unit cooler operation (cont.)

In some systems, electric drain pan heaters are used instead of a hot gas pan loop. Hot gas piping is simplified with the drain pan check valve being eliminated. Electric drain pan heaters are energized during the defrost period, by a defrost control on the unit cooler or by a compressor rack controller.

In order to provide sufficient re-evaporation of the liquid vapor mixture and sufficient heat for defrost, no more than one-third of the system should be defrosted at one time. Some means of control in the 3-pipe hot gas system should be supplied to regulate the large amount of liquid returning to the compressor, refrigerant slugging can otherwise damage the compressor.

REVERSE CYCLE THREE-PIPE DEFROST PIPING KEY COMPONENTS (FIG. 3)

- A. Hot gas drain pan loop
- B. Drain pan check valve
- C. Expansion valve
- D. Suction header
- E. Distributor

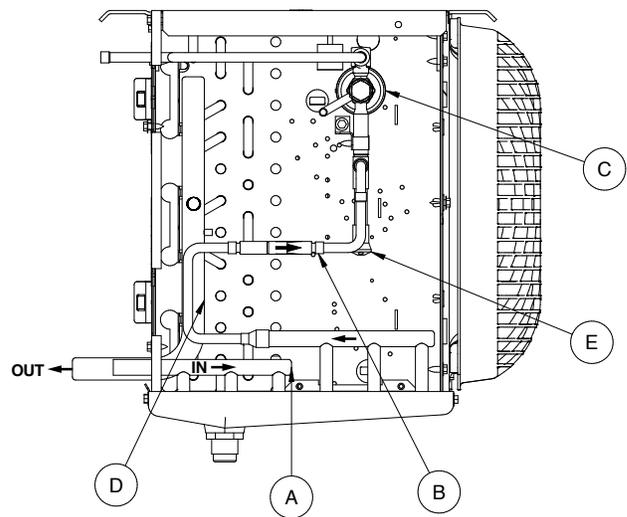

THREE-PIPE DEFROST PIPING KIT:

Three-pipe check valve kit (available factory-installed or for field installation) includes drain pan check valve and piping to connect the distributor side port to the hot gas drain pan loop. This kit is only necessary when the unit cooler is equipped with a hot gas drain pan loop.

Hot gas defrost controls:

Hot gas unit coolers are factory equipped with temperature control(s) that terminate the defrost cycle when the evaporator coil is clear of frost. After defrost, the control(s) keep the evaporator fans from re-energizing until the coil temperature is close to the freezing point.

STANDARD:

The standard control scheme includes an electromechanical defrost termination / fan delay control.

For reverse cycle defrost, the control sensing bulb is placed on the expansion valve bypass line, between the distributor side port and the expansion valve bypass check valve.

For three-pipe defrost, the control sensing bulb is placed on the suction header or suction header outlet connection.

OPTIONAL:

The optional control scheme includes an electromechanical defrost termination control and a separate bimetallic fan delay control. This scheme provides more options for the placement of the control sensing bulb as the defrost termination and fan delay sensing points are no longer combined.

The fan delay temperature is sensed on the evaporator coil endplate adjacent to the fins.

For reverse cycle defrost, the control sensing bulb is placed on the expansion valve bypass line or liquid line piping adjacent to the unit cooler.

For three-pipe defrost, the control sensing bulb is placed on the suction header or suction header outlet connection.

REPLACEMENT PARTS

Motor/Motor Mounts

Part #	Motor Type	Voltage	Motor Speeds	Motor Mount
25312501S / 25329001S	EC	115	1-SP / 2-SP	23108401*
25312601S / 25329101S	EC	208-230	2-SP	23108401*
25317701S	EC	208-230	1-SP	23108401
25309501S	PSC	115	1-SP	23108401
25309801S	PSC	208-230	1-SP	23108401
25309701S	PSC	460	1-SP	23106401

* = Consult factory when replacing motor mounts for motors 25329001S / 23529101S

Fan Blade

Part #	Description
5140C	Fan Blade 12" Std
5110E	Fan Blade 12" Reverse Air Flow

Fan Guard

Part #	Description
37001601	Fan Guard Wire Blue
37001801	Fan Guard Molded Blue

Cabinet Components

Part #	No. of Fans	Description	Defrost Type	Cabinet Aluminum	Application Notes
40594101	1	Drain Pan	Air/Hot Gas	Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40595101	1	Drain Pan	Air/Hot Gas	White Painted Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40596101	1	Drain Pan	Air/Hot Gas	Stainless Steel	Air Defrost Only
40594201	2	Drain Pan	Air/Hot Gas	Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40595201	2	Drain Pan	Air/Hot Gas	White Painted Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40596201	2	Drain Pan	Air/Hot Gas	Stainless Steel	Air Defrost Only
40594301	3	Drain Pan	Air/Hot Gas	Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40595301	4	Drain Pan	Air/Hot Gas	White Painted Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40596301	4	Drain Pan	Air/Hot Gas	Stainless Steel	Air Defrost Only
40594401	4	Drain Pan	Air/Hot Gas	Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40595401	4	Drain Pan	Air/Hot Gas	White Painted Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40596401	4	Drain Pan	Air/Hot Gas	Stainless Steel	Air Defrost Only
40594501	5	Drain Pan	Air/Hot Gas	Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40595501	5	Drain Pan	Air/Hot Gas	White Painted Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40596501	5	Drain Pan	Air/Hot Gas	Stainless Steel	Air Defrost Only
40594601	6	Drain Pan	Air/Hot Gas	Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40595601	6	Drain Pan	Air/Hot Gas	White Painted Aluminum	Air, Hot Gas Models w/Drain Pan Loop
40596601	6	Drain Pan	Air/Hot Gas	Stainless Steel	Air Defrost Only

REPLACEMENT PARTS

Cabinet Components (cont.)

Part #	No. of Fans	Description	Defrost Type	Cabinet Aluminum	Application Notes
40594102	1	Drain Pan	Electric/Hot Gas	Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40595102	1	Drain Pan	Electric/Hot Gas	White Painted Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40594202	2	Drain Pan	Electric/Hot Gas	Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40595202	2	Drain Pan	Electric/Hot Gas	White Painted Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40594302	3	Drain Pan	Electric/Hot Gas	Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40595302	3	Drain Pan	Electric/Hot Gas	White Painted Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40594402	4	Drain Pan	Electric/Hot Gas	Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40595402	4	Drain Pan	Electric/Hot Gas	White Painted Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40594502	5	Drain Pan	Electric/Hot Gas	Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40595502	5	Drain Pan	Electric/Hot Gas	White Painted Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40594602	6	Drain Pan	Electric/Hot Gas	Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40595602	6	Drain Pan	Electric/Hot Gas	White Painted Aluminum	Elec, Hot Gas Models w/Drain Pan Heater
40593703	1	Insulated Outer Drain Pan Assy	All	Aluminum	Includes Outer Cover and Insulation
40593704	1	Insulated Outer Drain Pan Assy	All	White Painted Aluminum	Includes Outer Cover and Insulation
40593002	1	Insulated Outer Drain Pan Assy	All	Stainless Steel	Includes Outer Cover and Insulation
40593803	2	Insulated Outer Drain Pan Assy	All	Aluminum	Includes Outer Cover and Insulation
40593804	2	Insulated Outer Drain Pan Assy	All	White Painted Aluminum	Includes Outer Cover and Insulation
40593102	2	Insulated Outer Drain Pan Assy	All	Stainless Steel	Includes Outer Cover and Insulation
40591503	3	Insulated Outer Drain Pan Assy	All	Aluminum	Includes Outer Cover and Insulation
40591504	3	Insulated Outer Drain Pan Assy	All	White Painted Aluminum	Includes Outer Cover and Insulation
40593202	3	Insulated Outer Drain Pan Assy	All	Stainless Steel	Includes Outer Cover and Insulation
40591603	4	Insulated Outer Drain Pan Assy	All	Aluminum	Includes Outer Cover and Insulation
40591604	4	Insulated Outer Drain Pan Assy	All	White Painted Aluminum	Includes Outer Cover and Insulation
40593302	4	Insulated Outer Drain Pan Assy	All	Stainless Steel	Includes Outer Cover and Insulation
40591703	5	Insulated Outer Drain Pan Assy	All	Aluminum	Includes Outer Cover and Insulation
40591704	5	Insulated Outer Drain Pan Assy	All	White Painted Aluminum	Includes Outer Cover and Insulation
40593402	5	Insulated Outer Drain Pan Assy	All	Stainless Steel	Includes Outer Cover and Insulation
40591803	6	Insulated Outer Drain Pan Assy	All	Aluminum	Includes Outer Cover and Insulation

REPLACEMENT PARTS

Cabinet Components (cont.)

Part #	No. of Fans	Description	Defrost Type	Cabinet Aluminum	Application Notes
40591804	6	Insulated Outer Drain Pan Assy	All	White Painted Aluminum	Includes Outer Cover and Insulation
40593502	6	Insulated Outer Drain Pan Assy	All	Stainless Steel	Includes Outer Cover and Insulation
41032901	All	Access Panel RH (Elect) End	All	Aluminum/Stainless Steel	All w/Unpainted Cabinet
41032902	All	Access Panel RH (Elect) End	All	White Painted Aluminum	All w/White Cabinet
41032801	All	Access Panel LH (Refrig) End	All	Aluminum/Stainless Steel	Standard w/Unpainted Cabinet
41032802	All	Access Panel LH (Refrig) End	All	White Painted Aluminum	Standard w/White Cabinet
41032803	All	Access Panel LH (Refrig) End	Air/Electric	Aluminum/Stainless Steel	IntelliGen/QRC/Beacon II w/Unpainted Cabinet
41032804	All	Access Panel LH (Refrig) End	Air/Electric	White Painted Aluminum	IntelliGen/QRC/Beacon II w/White Cabinet
41038401	All	Access Panel LH (Refrig) End	Air/Electric	Aluminum	Glycol/CO ₂ Overfeed Only
41038402	All	Access Panel LH (Refrig) End	Air/Electric	White Painted Aluminum	Glycol/CO ₂ Overfeed Only
41038501	All	Access Panel LH (Refrig) End	Air/Electric	Stainless Steel	Glycol/CO ₂ Overfeed Only
41038701	All	Access Panel RH (Elect) End	Air/Electric	Aluminum	Glycol/CO ₂
41038702	All	Access Panel RH (Elect) End	Air/Electric	White Painted Aluminum	Glycol/CO ₂
41038901	All	Access Panel RH (Elect) End	Air/Electric	Stainless Steel	Glycol/CO ₂

Drain Pan Heaters

Part #	No. of Fans	Voltage	Wattage	Defrost Type	Application Notes
24753101	1	115	150	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753102	2	115	300	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753103	3	115	450	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753104	4	115	600	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753105	5	115	750	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753106	6	115	900	Hot Gas	Hot Gas Models w/Drain Pan Heater
24752501	1	230	150	Electric /Hot Gas	Elec, Hot Gas Models w/Drain Pan Heater
24752502	2	230	300	Electric /Hot Gas	Elec, Hot Gas Models w/Drain Pan Heater
24752503	3	230	450	Electric /Hot Gas	Elec, Hot Gas Models w/Drain Pan Heater
24752504	4	230	600	Electric /Hot Gas	Elec, Hot Gas Models w/Drain Pan Heater
24752505	5	230	750	Electric /Hot Gas	Elec, Hot Gas Models w/Drain Pan Heater
24752506	6	230	900	Electric /Hot Gas	Elec, Hot Gas Models w/Drain Pan Heater
24753201	1	460	150	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753202	2	460	300	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753203	3	460	450	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753204	4	460	600	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753205	5	460	750	Hot Gas	Hot Gas Models w/Drain Pan Heater
24753206	6	460	900	Hot Gas	Hot Gas Models w/Drain Pan Heater

REPLACEMENT PARTS

Coil Defrost Heaters

Part #	No. of Fans	Voltage	Wattage	Defrost Type
24752001	1	230	300	Electric
24752002	2	230	600	Electric
24752003	3	230	900	Electric
24752004	4	230	1,200	Electric
24752005	5	230	1,500	Electric
24752006	6	230	1,800	Electric
24754101*	1	230	150	Electric
24754102*	2	230	300	Electric
24754103*	3	230	450	Electric
24754104*	4	230	600	Electric
24754105*	5	230	750	Electric
24754106*	6	230	900	Electric

* = One used per 460V unit only, top coil heater position

Electrical Components

Part #	Description	Defrost Type	Application Notes
22597101	Terminal Board	Air	All
22597701	Terminal Board	Electric/Hot Gas	All
5709L	Defrost Termination/Fan Delay Thermostat	Electric	Fixed Bi-Metallic Control
5708L	Heater Limit Thermostat	Electric	Fixed Bi-Metallic Control
4267W	Defrost Termination/Fan Delay Thermostat	Electric/Hot Gas	Adjustable Control
28913901	Room Thermostat	Air/Electric	Room Thermostat Mech
28963201	Room Thermostat	Air/Electric	Room Thermostat Elec

Drain Fitting

Part #	Description	Application Notes
26925101	Drain Fitting Kit	All

A2L Refrigeration Detection System

Part #	Description
A2L Refrigeration Detection System (RDS) Kit	
89727501	ASSY-A2L RDS FIELD INSTALL, LOP
Field Installed Safety Shut Off Valve	
90050201	ASSY-A2L SOLENOID SGUT-OFF VLV 3/8 LIQ-1
90050202	ASSY-A2L SOLENOID SGUT-OFF VLV 3/8 LIQ-2
Field Installed Safety Check Valve	
90050302	ASSY-A2L CHECK SHUT-OFF VALVE 5/8 SUC
90050303	ASSY-A2L CHECK SHUT-OFF VALVE 7/8 SUC
90050304	ASSY-A2L CHECK SHUT-OFF VALVE 1-1/8 SUC

Part #	Description
A2L Mitigation Sensor (Replacement Part)	
89724501	ASSY-LP, A2L LEAK SENSOR KIT
A2L Mitigation Controller (Replacement Part)	
89725001	ASSY-LP, A2L RDS CONTROL BOARD KIT
Control Power Transformer	
22529601	TRANSFORMER, 120V-24V 40 VA
22529602	TRANSFORMER, 208V/240V-24V 40 VA

STANDARD NOZZLE SELECTION

Air Defrost

Medium Temperature (25°F SST)												
Model	No. of Fans	Distributor Tube (in.)		No. of Circuits	Nozzle Selections							
		OD	Length		R-404A/ R-507A	R-448A/ R-449A	R-407A/ R-407F	R-407C	R-454A	R-454C	R-455A	
CEL0045*±6A^A	1	3/16	15	1	-	-	-	-	-	-	-	-
CEL0055*±6A^A	1	3/16	15	2	L-1/3	L-1/2	L-1/3	L-1/3	L-1/3	L-1/3	L-1/3	L-1/2
CEL0060*±6A^A	1	3/16	15	2	L-1/2	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-1/2	L-1/2
CEL0095*±6A^A	2	3/16	15	2	L-1/2	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-1/2	L-3/4
CEL0105*±6A^A	2	3/16	15	3	L-3/4	L-1	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	L-1
CEL0115*±6A^A	2	3/16	15	4	L-1	L-1 1/2	L-1	L-1	L-3/4	L-3/4	L-3/4	L-1
CEL0125*±6A^A	2	3/16	15	4	L-1	L-1 1/2	L-1	L-1	L-1	L-3/4	L-3/4	L-1
CEL0155*±6A^A	3	3/16	15	4	L-1	L-1 1/2	L-1	L-1	L-1	L-1	L-1	L-1 1/2
CEL0190*±6A^A	3	3/16	15	6	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2
CEL0250*±6A^A	4	3/16	15	6	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-2
CEL0295*±6A^A	5	3/16	15	6	L-2	L-2 1/2	L-1 1/2	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-2
CEL0350*±6A^A	6	3/16	15	7	L-2	L-3	L-2	L-2	L-2	L-2	L-2	L-2 1/2
CEL0380*±6A^A	6	3/16	15	8	L-2 1/2	L-3	L-2 1/2	L-2 1/2	L-2 1/2	L-2 1/2	L-2 1/2	L-3

Notes:

Nozzles sized for 90-100°F liquid temperature at expansion valve.
 Contact Application Engineering for guidance if:
 - Liquid temperature is not 90-100°F
 - Evaporator TD is not 10°-15°F (room temperature – saturated suction temperature)
 Caution: Refrigeration system will not perform properly without correct nozzle
 * = Electrical Code Designator (see Nomenclature details)
 ± = Refrigerant Designator

STANDARD NOZZLE SELECTION

Electric Defrost

Low Temperature (-20°F SST)												
Model	No. of Fans	Distributor Tube (in.)		No. of Circuits	Nozzle Selections							
		OD	Length		R-404A/ R-507A	R-448A/ R-449A	R-407A/ R-407F	R-407C	R-454A	R-454C	R-455A	
CEL0040*±6E^A	1	3/16	15	2	L-1/2	L-3/4	L-1/2	-	L-1/3	L-1/3	L-1/2	
CEL0045*±6E^A	1	3/16	15	2	L-3/4	L-3/4	L-1/2	-	L-1/2	L-1/2	L-3/4	
CEL0065*±6E^A	2	3/16	15	3	L-3/4	L-1	L-3/4	-	L-3/4	L-3/4	L-3/4	
CEL0080*±6E^A	2	3/16	15	3	L-1	L-1 1/2	L-1	-	L-3/4	L-3/4	L-1	
CEL0100*±6E^A	2	3/16	15	6	L-1 1/2	L-1 1/2	L-1	-	L-1	L-1	L-1 1/2	
CEL0130*±6E^A	3	3/16	15	6	L-1 1/2	L-2	L-1 1/2	-	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0155*±6E^A	3	3/16	15	8	L-2	L-2 1/2	L-2	-	L-1 1/2	L-1 1/2	L-2	
CEL0170*±6E^A	4	3/16	15	6	L-2	L-2 1/2	L-2	-	L-2	L-2	L-2	
CEL0205*±6E^A	4	3/16	15	8	L-2 1/2	L-3	L-2	-	L-2	L-2	L-2	
CEL0240*±6E^A	5	3/16	15	8	L-2 1/2	L-4	L-2 1/2	-	L-2	L-2	L-2 1/2	
CEL0255*±6E^A	6	3/16	15	9	L-3	L-4	L-3	-	L-2 1/2	L-2 1/2	L-3	
CEL0310*±6E^A	6	3/16	15	12	L-4	L-5	L-3	-	L-3	L-3	L-4	
CEL0045*±4E^A	1	3/16	15	2	L-1/2	L-3/4	L-1/2	-	L-1/2	L-1/2	L-1/2	
CEL0070*±4E^A	2	3/16	15	3	L-3/4	L-1	L-3/4	-	L-3/4	L-3/4	L-3/4	
CEL0090*±4E^A	2	3/16	15	6	L-1	L-1 1/2	L-1	-	L-1	L-1	L-1	
CEL0135*±4E^A	3	3/16	15	6	L-1 1/2	L-2	L-1 1/2	-	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0180*±4E^A	4	3/16	15	8	L-2	L-2 1/2	L-2	-	L-1 1/2	L-1 1/2	L-2	
CEL0220*±4E^A	5	3/16	15	8	L-2	L-3	L-2	-	L-2	L-2	L-2	
CEL0275*±4E^A	6	3/16	15	12	L-3	L-4	L-3	-	L-2 1/2	L-2 1/2	L-3	

Medium Temperature (25°F SST)												
Model	No. of Fans	Distributor Tube (in.)		No. of Circuits	Nozzle Selections							
		OD	Length		R-404A/ R-507A	R-448A/ R-449A	R-407A/ R-407F	R-407C	R-454A	R-454C	R-455A	
CEL0040*±6E^A	1	3/16	15	2	L-1/4	L-1/3	L-1/4	L-1/4	L-1/4	L-1/4	L-1/4	
CEL0045*±6E^A	1	3/16	15	2	L-1/3	L-1/2	L-1/3	L-1/3	L-1/3	L-1/3	L-1/3	
CEL0065*±6E^A	2	3/16	15	3	L-1/2	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-1/2	
CEL0080*±6E^A	2	3/16	15	3	L-3/4	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-3/4	
CEL0100*±6E^A	2	3/16	15	6	L-3/4	L-1	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	
CEL0130*±6E^A	3	3/16	15	6	L-1	L-1 1/2	L-1	L-1	L-1	L-1	L-1	
CEL0155*±6E^A	3	3/16	15	8	L-1	L-1 1/2	L-1	L-1	L-1	L-1	L-1 1/2	
CEL0170*±6E^A	4	3/16	15	6	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0205*±6E^A	4	3/16	15	8	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0240*±6E^A	5	3/16	15	8	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-2	
CEL0255*±6E^A	6	3/16	15	9	L-2	L-2 1/2	L-2	L-2	L-2	L-2	L-2	
CEL0310*±6E^A	6	3/16	15	12	L-2	L-3	L-2	L-2	L-2	L-2	L-2 1/2	
CEL0045*±4E^A	1	3/16	15	2	L-1/3	L-1/2	L-1/4	L-1/4	L-1/4	L-1/4	L-1/3	
CEL0070*±4E^A	2	3/16	15	3	L-1/2	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-3/4	
CEL0090*±4E^A	2	3/16	15	6	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	
CEL0135*±4E^A	3	3/16	15	6	L-3/4	L-1	L-3/4	L-3/4	L-3/4	L-3/4	L-1	
CEL0180*±4E^A	4	3/16	15	8	L-1	L-1 1/2	L-1	L-1	L-1	L-1	L-1 1/2	
CEL0220*±4E^A	5	3/16	15	8	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0275*±4E^A	6	3/16	15	12	L-2	L-2 1/2	L-2	L-2	L-2	L-2	L-2	

Notes:

Nozzles sized for 90-100°F liquid temperature at expansion valve.
 Contact Application Engineering for guidance if:
 - Liquid temperature is not 90-100°F
 - Evaporator TD is not 10°-15°F (room temperature – saturated suction temperature)
 Caution: Refrigeration system will not perform properly without correct nozzle
 * = Electrical Code Designator (see Nomenclature details)
 ± = Refrigerant Designator

STANDARD NOZZLE SELECTION

Hot Gas Defrost

Low Temperature (-20°F SST)												
Model	No. of Fans	Distributor Tube (in.)		No. of Circuits	Nozzle Selections							
		OD	Length		R-404A/ R-507A	R-448A/ R-449A	R-407A/ R-407F	R-407C	R-454A	R-454C	R-455A	
CEL0040*±6H^A	1	3/16	15	2	L-1/2	L-3/4	L-1/2	-	L-1/3	L-1/3	L-1/2	
CEL0045*±6H^A	1	3/16	15	2	L-3/4	L-3/4	L-1/2	-	L-1/2	L-1/2	L-3/4	
CEL0065*±6H^A	2	3/16	15	3	L-3/4	L-1	L-3/4	-	L-3/4	L-3/4	L-3/4	
CEL0080*±6H^A	2	3/16	15	3	L-1	L-1 1/2	L-1	-	L-3/4	L-3/4	L-1	
CEL0100*±6H^A	2	3/16	15	6	L-1 1/2	L-1 1/2	L-1	-	L-1	L-1	L-1 1/2	
CEL0130*±6H^A	3	3/16	15	6	L-1 1/2	L-2	L-1 1/2	-	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0155*±6H^A	3	3/16	15	8	L-2	L-2 1/2	L-2	-	L-1 1/2	L-1 1/2	L-2	
CEL0170*±6H^A	4	3/16	15	6	L-2	L-2 1/2	L-2	-	L-2	L-2	L-2	
CEL0205*±6H^A	4	3/16	15	8	L-2 1/2	L-3	L-2	-	L-2	L-2	L-2	
CEL0240*±6H^A	5	3/16	15	8	L-2 1/2	L-4	L-2 1/2	-	L-2	L-2	L-2 1/2	
CEL0255*±6H^A	6	3/16	15	9	L-3	L-4	L-3	-	L-2 1/2	L-2 1/2	L-3	
CEL0310*±6H^A	6	3/16	15	12	L-4	L-5	L-3	-	L-3	L-3	L-4	
CEL0045*±4H^A	1	3/16	15	2	L-1/2	L-3/4	L-1/2	-	L-1/2	L-1/2	L-1/2	
CEL0070*±4H^A	2	3/16	15	3	L-3/4	L-1	L-3/4	-	L-3/4	L-3/4	L-3/4	
CEL0090*±4H^A	2	3/16	15	6	L-1	L-1 1/2	L-1	-	L-1	L-1	L-1	
CEL0135*±4H^A	3	3/16	15	6	L-1 1/2	L-2	L-1 1/2	-	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0180*±4H^A	4	3/16	15	8	L-2	L-2 1/2	L-2	-	L-1 1/2	L-1 1/2	L-2	
CEL0220*±4H^A	5	3/16	15	8	L-2	L-3	L-2	-	L-2	L-2	L-2	
CEL0275*±4H^A	6	3/16	15	12	L-3	L-4	L-3	-	L-2 1/2	L-2 1/2	L-3	

Medium Temperature (25°F SST)												
Model	No. of Fans	Distributor Tube (in.)		No. of Circuits	Nozzle Selections							
		OD	Length		R-404A/ R-507A	R-448A/ R-449A	R-407A/ R-407F	R-407C	R-454A	R-454C	R-455A	
CEL0040*±6H^A	1	3/16	15	2	L-1/4	L-1/3	L-1/4	L-1/4	L-1/4	L-1/4	L-1/4	
CEL0045*±6H^A	1	3/16	15	2	L-1/3	L-1/2	L-1/3	L-1/3	L-1/3	L-1/3	L-1/3	
CEL0065*±6H^A	2	3/16	15	3	L-1/2	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-1/2	
CEL0080*±6H^A	2	3/16	15	3	L-3/4	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-3/4	
CEL0100*±6H^A	2	3/16	15	6	L-3/4	L-1	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	
CEL0130*±6H^A	3	3/16	15	6	L-1	L-1 1/2	L-1	L-1	L-1	L-1	L-1	
CEL0155*±6H^A	3	3/16	15	8	L-1	L-1 1/2	L-1	L-1	L-1	L-1	L-1 1/2	
CEL0170*±6H^A	4	3/16	15	6	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0205*±6H^A	4	3/16	15	8	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0240*±6H^A	5	3/16	15	8	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-2	
CEL0255*±6H^A	6	3/16	15	9	L-2	L-2 1/2	L-2	L-2	L-2	L-2	L-2	
CEL0310*±6H^A	6	3/16	15	12	L-2	L-3	L-2	L-2	L-2	L-2	L-2 1/2	
CEL0045*±4H^A	1	3/16	15	2	L-1/3	L-1/2	L-1/4	L-1/4	L-1/4	L-1/4	L-1/3	
CEL0070*±4H^A	2	3/16	15	3	L-1/2	L-3/4	L-1/2	L-1/2	L-1/2	L-1/2	L-3/4	
CEL0090*±4H^A	2	3/16	15	6	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	L-3/4	
CEL0135*±4H^A	3	3/16	15	6	L-3/4	L-1	L-3/4	L-3/4	L-3/4	L-3/4	L-1	
CEL0180*±4H^A	4	3/16	15	8	L-1	L-1 1/2	L-1	L-1	L-1	L-1	L-1 1/2	
CEL0220*±4H^A	5	3/16	15	8	L-1 1/2	L-2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	L-1 1/2	
CEL0275*±4H^A	6	3/16	15	12	L-2	L-2 1/2	L-2	L-2	L-2	L-2	L-2	

Notes:

Nozzles sized for 90-100°F liquid temperature at expansion valve.
 Contact Application Engineering for guidance if:
 - Liquid temperature is not 90-100°F
 - Evaporator TD is not 10°-15°F (room temperature – saturated suction temperature)
 Caution: Refrigeration system will not perform properly without correct nozzle
 * = Electrical Code Designator (see Nomenclature details)
 ± = Refrigerant Designator



2175 West Park Place Blvd.

Stone Mountain, GA 30087

Phone: 800.537.7775 · Fax: 770.465.5900

heatcraftprd.com

Since product improvement is a continuing effort, we reserve the right to make changes in specifications without notice.

CC-LOP-0525 | Version 008

©2025 Heatcraft Refrigeration Products LLC